


MAINS SIDE

**PANEL PILLAR
RESIDENTIAL DISTRIBUTION**

ITEM NUMBER: 3517

NOTES:

1. FOR PANEL INSTALLATION DETAIL SEE DRG No. S02-02-03-02.
2. BIMETAL LUGS TO BE USED FOR TERMINATING ALUMINIUM CONDUCTOR. REFER TO S02-01-02-22.
3. PANEL TO BE 400A NOMINAL RATING. FLAT WASHERS TO BE CAD PLATED STEEL, EXTRA LARGE AS PER AS1237 TABLE 1.
4. NEUTRAL BUSBAR KIT SHALL BE USED FOR REPLACING NEUTRAL BUSBAR ON MAINS SIDE TO PROVIDE ADDITIONAL NEUTRAL CONNECTIONS.

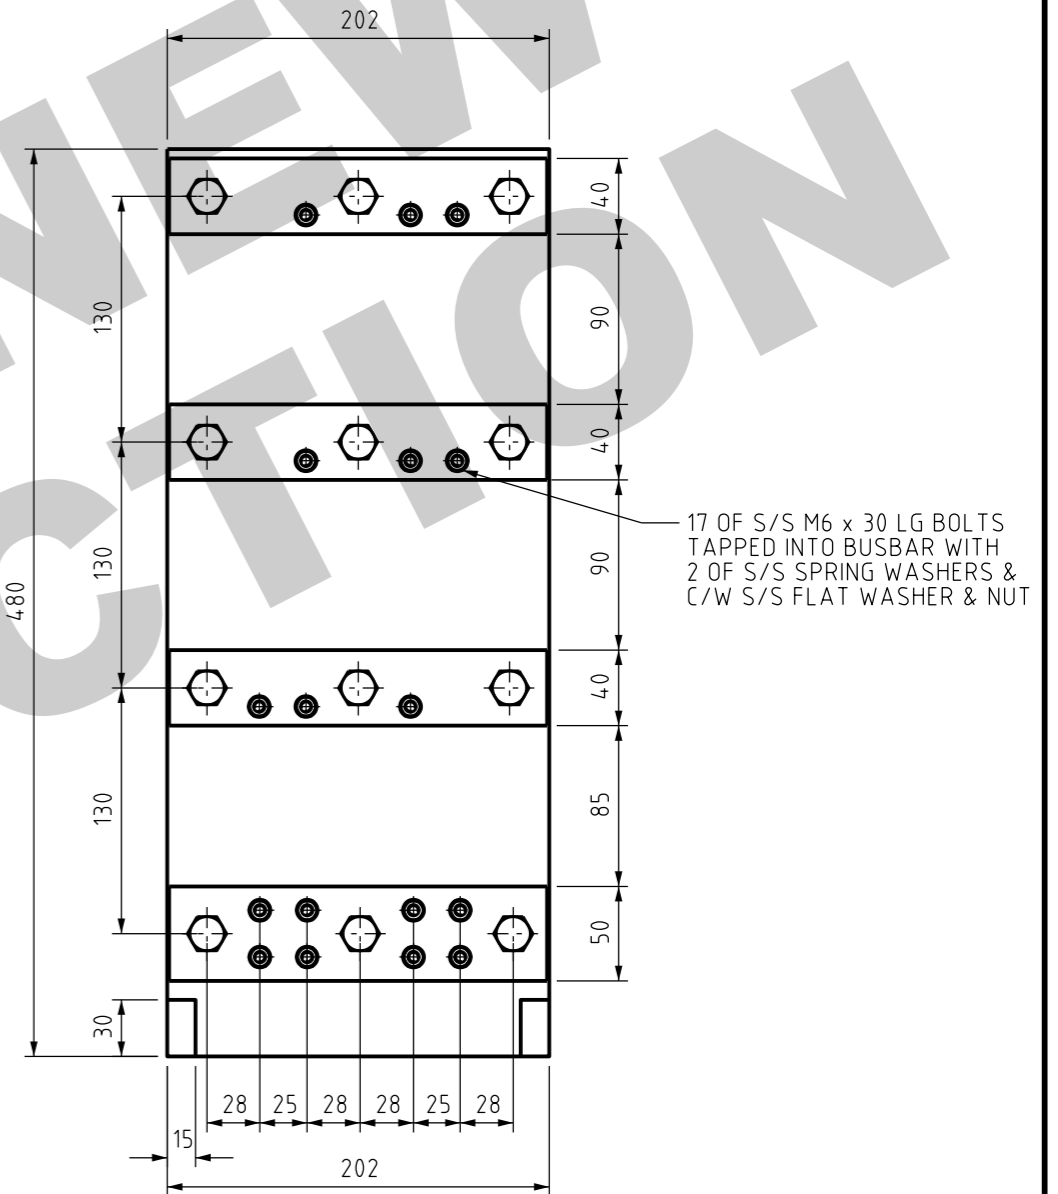

SERVICE SIDE

NEUTRAL BUSBAR KIT (SEE NOTE 4)
C/W 8 x M16 BOLT ASSEMBLIES
AND SPACER WASHERS
ITEM NUMBER: 504228

14	ADDED 'NOT FOR NEW CONSTRUCTION'. AMENDED NOTE 2.	A.N.	AUG'21	C.C.C.	B.V.
13	NEUTRAL BUSBAR KIT & NOTE 4 ADDED	C.C.	FEB'19	B.V.	B.V.
12	BAKELITE CHANGED TO BRAMITE	K.I.	MAR'05	C.C.	C.C.
11	CENTER PHASE SPACERS NOW TIN/Cu	G.M.	JUL'93	-	-
10	TITLE & DRG NUMBER CHANGED	A.F.	MAY'88	-	-
9	ITEM No. 8 STOCK CODE AMENDED	W.T.	MAR'87	-	-
8	STOCK CODE AMENDED	W.T.	JAN'87	-	-
7	BELLVILLE WASHER REMOVED	R.P.	OCT'86	-	-
6	BUSBARS CHANGED TO TINNED COPPER	T.R.	FEB'86	-	-
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					



DES	J.HASSANEN	POWER STANDARD DRAWING			
DRN	R.HAIGH	DISTRIBUTION PILLARS RESIDENTIAL TYPE PANEL			
CKD	G.McSHANAG				
APPD					
SCALE	N.T.S.				
ISSUED	FEBRUARY 1986	A3	DRAWING NUMBER	S02-01-03-05	14
ALL DIM. IN mm		CAD PRODUCT - DO NOT AMEND MANUALLY		AMDT	
DRAFTING STANDARD TO A.S.1100					