

**Negotiated Embedded
Generation Technical
Requirements
Specification – greater
than 30kVA, less than or
equal to 2000kVA**

December 2023

Table of contents

1	Introduction	3
1.1	Purpose	3
1.2	Scope	3
1.3	Obligations of proponents	4
<hr/>		
2	Definitions and abbreviations	5
2.1	Definitions	5
2.2	Abbreviations	7
2.3	Terminology	7
<hr/>		
3	Relevant rules, regulations, standards and codes	9
3.1	Standards and codes	9
3.2	Legislation and regulation	10
<hr/>		
4	Technical requirements	11
4.1	Labelling and signage	11
4.2	Maximum system capacity	11
4.3	Generation control	11
4.4	Inverter energy system	13
4.5	Network connection and isolation	13
4.6	Earthing	14
4.7	Protection	14
4.8	Operating voltage and frequency	17
4.9	Metering	18
4.10	Power quality	18
4.11	Communications systems	19
4.12	Data and information	19
4.13	Cyber security	20
4.14	Technical studies	20
<hr/>		
5	Fees and charges	22
6	Testing and commissioning	22
7	Operations and maintenance	23
<hr/>		

Appendix A: Deviations from the national DER connection guidelines	24
Appendix B: Connection arrangement requirements	26
B1 Single line diagram	26
Appendix C: Connection agreement	27
Appendix D: Static data and information	27

1 Introduction

1.1 Purpose

This technical requirements document provides proponents of negotiated embedded generation (EG) connections information about their obligations for connection to and interfacing with the Power and Water Corporation (Power and Water) network.

1.2 Scope

This technical requirements document applies to new connections of negotiated EG systems or modifications to existing EG systems, where the EG system consists of an inverter energy system (IES), energy storage system (ESS) or a combination of both.

An EG system has a total system capacity less than or equal to 2000kVA or a lower regional threshold as determined by Power and Water and connected via low voltage for a three-phase IES (with or without ESS) network connection, that is:

- a. Intended to be connected to and capable of operating in parallel with the Darwin, Alice Springs, Katherine, and Tennant Creek networks¹
- b. Meeting all other technical and cyber security requirements set out in this document. ^{2 3}

The scope of this technical standard does not include:

- a. EG units covered by Power and Water's Basic Micro EG Technical Requirements Specification (<30 kVA) (Basic Micro EG Connection Technical Requirements)
- b. EG systems with a capacity over 2000kVA or the regional threshold
- c. Non-IES systems
- d. Electric vehicles unless the onboard battery storage is capable of generating (in which case the requirements shall apply)
- e. EG units where the customer's connection voltage is at HV.

This technical requirements document complies with the National DER Connection Guidelines for Low Voltage EG Connections as published by Energy Networks Australia, with the exception of the deviations presented in Appendix A: Deviations from the National DER Connection Guidelines.

¹ For connections to other parts of the network (e.g. remote networks and minor centres) please contact Power and Water as bespoke requirements will apply

² Note that ESS are permitted within negotiated EG connections. The total system capacity definition of the negotiated EG connection includes the IES and the AC-coupled ESS inverter capacity.

³ For single-phase or three-phase connections ≤ 30 kVA that do not meet the requirements of the *Basic micro EG technical requirements* document, the connection shall comply with the technical requirements in this document.

1.3 Obligations of proponents

Proponents shall comply with all of the applicable requirements of this document.

The general obligations of proponents include:

- a. The obligation to comply with the technical requirements as well as relevant national standards, industry codes, legislation, and regulations. In the event of inconsistency, an indication of which instrument shall prevail, being legislation and regulations, followed by the technical requirements, followed by national standards and industry codes
- b. The obligation to not connect additional inverters, make modifications including inverter/protection settings or install additional EG units or the addition or removal of DC capacity including ESS, without prior written agreement from Power and Water
- c. The obligation to comply with Power and Water's connection agreement
- d. The obligation to meet the requirements in the design, installation, and operation of the EG system
- e. The obligation to meet the connection and commissioning requirements to the distribution network.

Power and Water's obligations are to ensure the safe and reliable operation of the distribution system for operating personnel, customers, and the general public.

2 Definitions and abbreviations

2.1 Definitions

Term	Definition
Basic micro embedded generation connection	A connection between a distribution network and a retail customer's premises for a micro embedded generating unit, for which a model standing offer is in place.
Central protection	Central protection is the protection contemplated by AS/NZS 4777 (grid connection of energy systems via inverters) installed to perform the functions of: coordinating multiple inverter energy system installations at one site, providing protection for the entire inverter energy system installation and islanding protection to the connected grid as well as preserving safety of grid personnel and the general public.
Connection point	An agreed point of supply ⁴ established between the distribution network service provider and the proponent.
Distributed energy resources	Power generation or storage units that are connected directly to the distribution network.
Dynamic export limit	A site export limit which is dynamically varied via a communications link to Power and Water's systems.
Embedded generating unit	A generating unit connected within a distribution network and not having direct access to the transmission network. Can include an energy storage system.
Embedded generating system	A system comprising of multiple embedded generating units.
Energy storage system	A system comprising one or more stores of energy supplied by distributed energy resources or directly from the network, and that can discharge the electricity to loads and/or the network.
Generating unit	The plant used in the production of electricity and all related equipment essential to its functioning as a single entity.
Generation	The production of electrical power by converting another form of energy in a generating unit.
Generator	A person or entity who owns, operates, or controls a generating unit.

⁴ Point of supply has the definition contemplated by the Power and Water Network Policy NP 003 Installation Rules, available from <https://www.powerwater.com.au/developers/power/design-and-construction-guidelines>

Term	Definition
Inverter energy system	A system comprising one or more inverters that convert direct current to alternating current. For the purposes of maximum system capacity in this document, the term inverter energy system includes the capacity of the sum of the inverter energy system capacity and AC-coupled energy storage system capacity.
Lot	A recognised subdivision of land with an owner.
Low voltage	The mains voltages as most commonly used in any given network by domestic and light industrial and commercial consumers (typically 230V).
Medium voltage/ High voltage	Any voltage greater than 1kVAC.
Micro embedded generation connection	Means a connection between an embedded generating unit and a distribution network of the kind contemplated by Australian Standard AS/NZS 4777 (Grid connection of energy systems via inverters) currently up to 200kVA.
Model standing offer	A document approved by the Australian Energy Regulator as a model standing offer to provide basic micro embedded generation connection services or standard connection services which contains (amongst other things) the safety and technical requirements to be complied with by the proponent.
Proponent	A person or entity proposing to become a generator (the relevant owner, operator, or controller of the generating unit (or their agent)).
Site generation limit	The generation threshold that the embedded generation system cannot exceed, measured downstream of the connection point.
Standard connection	A connection service (other than a basic micro embedded generation connection service) for a particular class (or sub-class) of connection applicant and for which an Australian Energy Regulator approved model standing offer is in place or for which an equivalent model offer is in place in jurisdictions not subject to Chapter 5A of the National Electricity Rules.
Static export limit	A site export limit defined as a non-changing value defined in the connection agreement.
Technical requirements document	This document, which sets out requirements for proponents to enable a grid connection.

Table 1: Definitions

2.2 Abbreviations

Abbreviation	Definition
AC	Alternating Current
AEMC	Australian Energy Market Commission
AEMO	Australian Energy Market Operator
AER	Australian Energy Regulator
API	Application Programming Interface
AS/NZS	A jointly developed Australian and New Zealand Standard
CEC	Clean Energy Council
CPEng	Chartered Professional Engineer of Engineers Australia
DC	Direct Current
DER	Distributed Energy Resources
DNSP	Distribution Network Service Provider
EG	Embedded Generation or Embedded Generating
ESS	Energy Storage System
HV	High Voltage
IEC	International Electrotechnical Commission
IES	Inverter Energy System
LV	Low Voltage
MV	Medium Voltage
NEM	National Electricity Market
NER	National Electricity Rules
NMI	National Metering Identifier
NT	Northern Territory

Table 2: Abbreviations

2.3 Terminology

Instructional terms are to be interpreted in the following way:

- The words 'shall' or 'must' indicate a mandatory requirement
- The word 'may' indicates a requirement that could be mandatorily imposed on the proponent
- The word 'should' indicates a recommendation that will not be mandatorily imposed on the proponent.

2.3.1 Sub-categories

The technical requirements set out in this document shall apply to all LV connected EG systems above 30kVA where Power and Water has assessed the system as a “Small Generating System” as defined in the Network Technical Code (NTC). An upper limit of 2000kVA shall apply in all instances.

Exporting systems shall be considered to be EG systems operating in parallel with the network and exporting electricity either via partial-export or full-export into the network, where:

- Static partial-export EG systems limit the amount of export into the network to an agreed export threshold defined in the connection agreement
- Static full-export EG systems can export into the network to the full EG nameplate capacity (full AC rating).
- Dynamic-export EG systems can export into the network up to the value provided by Power and Water’s Dynamic Control System.

Non-exporting systems shall be considered to be EG systems operating in parallel with the distribution network that are approved and limited to ensure they cannot export electricity into the distribution network.

The technical requirements set out in this document should be interpreted as applying to all subcategories of EG connections unless otherwise specified.

For all enquiries, Power and Water can be contacted via email:

EGApplications.PWC@powerwater.com.au

3 Relevant rules, regulations, standards and codes

3.1 Standards and codes

There are a range of applicable standards and industry codes which define connection types and requirements, and network standards as set out below.

In the event of any inconsistency between an applicable Australian/international standard or industry code (except for legislated industry codes) and these technical requirements, these technical requirements will prevail.

3.1.1 Australian and international standards and industry codes

The Australian and international standards and industry codes listed in Table 3 shall apply to the design, manufacture, installation, testing and commissioning, and operation and maintenance of all plant and equipment for basic micro EG connections to the distribution network.

Document number	Document name	Document type
AS/NZS 3000	Electrical Installations – Wiring Rules	AU/NZ Joint Standard
AS/NZS 4777	Grid connection of energy systems via inverters (multiple parts)	AU/NZ Joint Standard
AS/NZS 5033	Installation and Safety Requirements for Photovoltaic (PV) Arrays	AU/NZ Joint Standard
AS/NZS 5139	Electrical Installations - Safety of battery systems for use with power conversion equipment	AU/NZ Joint Standard
AS/NZS 61000	Electromagnetic compatibility (EMC) (multiple parts)	AU/NZ Joint Standard
IEC 62116	Utility-interconnected photovoltaic inverters – Test procedure of islanding prevention measures	International standard

Table 3: Applicable Standards

3.1.2 Related Power and Water documents

For further information on Power and Water’s network requirements, see Table 4 below. These shall apply to all connections to the Power and Water electricity network.

Document Title	Record Number
Embedded Generation Connection Guideline - NT NER Chapter 5/5A Information Pack	CONTROL0639
Installation rules⁵	NP003
Power networks service rules⁶	NP007
Meter manual⁷	NP010

Table 4: Internal references and documents

3.2 Legislation and regulation

The relevant legislation and regulations listed in Table 5 shall apply to the design, manufacture, installation, testing and commissioning, and operations and maintenance of all plant and equipment for basic micro EG connections to the network.

In the event where there is any inconsistency between legislation and regulations and these technical requirements, the legislation and regulations shall prevail.

Document name	Document type
National Electricity (NT) Rules	Regulation
Electricity Reform (Safety and Technical) Regulations 2000	Regulation
Network Technical Code	Code produced under Electricity Reform (Administration) Regulations
System Control Code	Code produced under Electricity Reform (Administration) Regulations
Critical Infrastructure Act 2021	Regulation
Australian Energy Sector Cyber Security Framework (AESCSF)	Code procedure under Critical Infrastructure Act

Table 5: Legislation and regulations

⁵ Power and Water, NP003 Installation Rules, available from <https://www.powerwater.com.au/developers/power/design-and-construction-guidelines>

⁶ Power and Water, NP007 Power networks service rules, available from <https://www.powerwater.com.au/developers/power/design-and-construction-guidelines>

⁷ Power and Water, NP010 Meter manual, available from <https://www.powerwater.com.au/developers/power/design-and-construction-guidelines>

4 Technical requirements

4.1 Labelling and signage

Labels and signs on the installation, including cables, shall meet the requirements of AS/NZS 4777.1, AS/NZS 3000, AS/NZS 5033 and AS/NZS 5139 as appropriate.

The IES must include warning signage to clearly indicate that the electrical installation has multiple supplies and identify which circuits are affected by these supplies.

Signage shall as a minimum be placed:

- a. On the switchboard that has the inverter energy system directly connected to it
- b. On all switchboards including main switchboard and distribution board(s) between the main switchboard and the board that has the inverter energy system directly connected to it
- c. In all meter boxes containing the distributor's metering equipment.

Signage should describe the actual type of generation source installed.

4.2 Maximum system capacity

The maximum system capacity of the EG connections shall be assessed by Power and Water as per the NTC to comply with a small generating system.

In circumstances where there are multiple connection points on a single lot, the system shall be treated as a negotiated contract and this standard shall not apply.

System capacity for multiple systems behind a single connection point (such as strata title lots e.g. retirement villages) are aggregated at the connection point and the values above apply on the aggregate value. The proponent is responsible for compliance with the requirements set out in this standard, including, but not limited to, phase balancing.

4.3 Generation control

Negotiated EG connections require generation control as specified in the following subsections.

4.3.1 Export limits at connection point

If export is requested by the proponent, the export limit at the connection point of EG connections will be assessed by Power and Water at the time of application.

Factors that are considered in determining the export limit include, but are not limited to:

- a. Existing network asset ratings
- b. Existing power quality at the relevant network location
- c. Existing and forecast DER penetration at the relevant network location
- d. Regional registration thresholds from the Power System Controller.

In circumstances where there are multiple connection points on a single lot, the export limit will be assessed as a negotiated contract.

The export limit is to be interpreted as 'soft', consistent with the definition of soft export limits within AS/NZS 4777.1.

The export limit is to be interpreted by the proponent as a maximum. The ability of the proponent's EG system to export at the export limit is not guaranteed, but rather, it will depend upon network characteristics, which change over time. The output of an EG system may need to be constrained for various scenarios including, but not limited to scenarios where power quality response modes are in operation.

Power and Water may require the installation of a dynamic export control device to support an increased export limit, which will be provided by Power and Water. The IES must follow the export limit provided by the dynamic control device and revert to the static limit when not functional.

4.3.2 Additional export limit requirements

The following are additional export limit requirements that shall apply to negotiated EG connections:

- a. The proponent shall ensure the EG system is technically capable of achieving the export limit requirements above at all times through the inverter(s), ESS and/or other export limiting device
- b. Certification from the inverter manufacturer(s) and where applicable export limiting device manufacturer shall be provided to Power and Water upon request to confirm that the export limit requirements in this document have been incorporated as a part of their design prior to approval (where applicable) ^{8 9}
- c. In the event of network or contractual constraints, the proponent or Power and Water may nominate that the EG connection must not export any energy
- d. The proponent shall ensure that the EG system reduces generation to no more than the static export limit upon loss of communications between the site energy meter and any export control limiting devices as per Clause 6.1 of AS/NZS 4777.2
- e. The export limit may be breached whilst the IES is responding to under frequency events as per Clause 4.4 of AS/NZS 4777.2
- f. Additional ESS requirements.

The following are additional ESS requirements that shall apply to negotiated EG connections:

- a. The proponent shall ensure that the ESS is technically capable of limiting its charge rate from the network. The maximum allowable charge rate will be determined by Power and Water at the time of application
- b. The AC inverter capacity for the ESS will be included in the aggregated nameplate rating of inverters within the premises behind the connection point (forming part of the proponent's installation)
- c. The export limit for the ESS inverter will be considered as part of the aggregated export limit at the connection point.

⁸ The certification issued by the inverter / limiting device manufacturer must be an electronic document that includes the following elements as a minimum; the relevant manufacturer's company name and logo, date, confirmation that the inverter has export limitation functionality and any associated equipment that must also be installed for its operation.

⁹ Additionally, export limit details are required to be provided by the installer via the Power and Water Embedded generation commissioning form (as per Section 6).

4.4 Inverter energy system

The following requirements apply to IES comprising of EG inverters:

- a. IES shall be tested by an authorised testing laboratory and be certified as being compliant with AS/NZS 4777.2 with an accreditation number
- b. IES shall comprise of inverters that are registered with CEC as approved grid connect inverters
- c. IES shall comprise of inverters that are tested by an authorised testing laboratory and certified as being compliant with IEC 62116 for active anti-islanding protection as per AS/NZS4777.2
- d. IES shall comprise of inverters installed in compliance with AS/NZS 4777.1
- e. IES shall comprise of inverters that have both volt-var and volt-watt response modes available
- f. The IES shall be set to the regional setting “Australia A” as per AS/NZS 4777.2
- g. IES should comprise of inverters that are capable of remaining in continuous operation through a 220 ms duration voltage dip to 50 V¹⁰.

The following requirements apply to IES with ESS:

- a. ESS shall comprise of batteries that are AS/NZS 5139 compliant, and be listed in the CEC approved batteries list (currently applies to lithium-based batteries only).
- b. ESS of storage capacity greater than 200kWh will require separate Power and Water approval.

4.5 Network connection and isolation

Network connection and isolation requirements shall be as per AS/NZS 4777.1 and AS/NZS 3000.

In addition, the following requirements shall apply:

- a. Mechanical isolation shall be as per AS/NZS 3000 in that the isolator must always be readily accessible
- b. Any means of isolation (where lockable) shall be able to be locked in the open position only.

4.5.1 Changeover switches

Any small IES unit connected behind a break-before-make switch, that is, it isolates the changeover circuit when transferring between grid supply to generation supply, will be considered as an off-grid inverter.

The following shall be considered as grid connected small IES units and will be required to comply with the requirements of this standard:

- a. A small IES unit connected behind a make-before-break switch that results in a momentary, or longer, connection between grid supply and generation supply circuits when performing a changeover
- b. A multiple mode inverter with uninterruptible power supply (UPS) mode functionality that is grid connected but also supplies an off-grid circuit.

¹⁰ The certification issued by the inverter manufacturer to AEMO’s Short Duration Undervoltage Response Test should be provided to Power and Water upon request. This test is available from <https://www.aemo.com.au/-/media/files/electricity/nem/der/2020/vdrt-test-procedure.pdf>

4.6 Earthing

The earthing requirements shall include:

- a. For IES, earthing requirements shall be as per AS/NZS 4777.1 and AS/NZS 3000
- b. For IES with ESS, earthing requirements shall be as per AS/NZS 5139.

4.7 Protection

4.7.1 Inverter integrated protection

The inverter integrated protection requirements for inverters connected to the network shall comply with AS/NZS 4777.1 and AS/NZS 4777.2 “Region Australia A” without modification as shown in Table 6 below.

Active anti-islanding requirements shall apply as per AS/NZS 4777.2 without modification.

Parameter	Settings	Trip delay time	Maximum disconnection time
Undervoltage 2 (V<<)	70 V	1 s	2 s
Undervoltage 1 (V<)	180 V	10 s	11 s
Overvoltage 1 (V>)	265 V	1 s	2 s
Overvoltage 2 (V>>)	275 V	—	0.2 s
Under-frequency (F<)	47 Hz	1 s	2 s
Over-frequency (F>)	52 Hz	—	0.2 s
Reconnect time	60 seconds	N/A	N/A

Table 6: Inverter integrated passive anti-islanding protection settings

4.7.2 Central protection

The central protection requirements are summarised in Table 7, with further details provided in sections 4.7.2.1 to 4.7.2.6 of this document.

Protection requirements	EG IES	
	Exporting	Non-exporting
Grid reverse power (32R)	x	x
Generator circuit phase balance protection (46/47)	—	—
Overcurrent facility fault, grid fault and earth fault protection (50/51)	—	—
Passive anti-islanding protection (27U/O, 59U/O, 81U/O, 81R)	✓	✓
Inter-tripping	x	x

Table 7: Central protection requirements

Note: Protection requirements consistent with AS/NZS 4777.1 are italicised.

Symbols are used to denote protection requirements, where:

- ✓ Represents that the protection shall be required
- Represents that the protection may be required which will be determined during the technical assessment if required.
- × Represents that the protection shall not be required

Where the fixed EG system comprises multiple inverters, all inverters on all three phases of the fixed EG system shall simultaneously disconnect from the distribution network in response to the operation of protection or automatic controls.

The central protection relay shall meet the following requirements:

- a. Coordinate multiple IES installations for one connection point
- b. Provide protection functionality using one relay for all IES installations for the one connection point
- c. Be integrated in such a way that it fails safe, and fixed EG system(s) do not generate whilst the GPR is out of service
- d. Open the isolation device at either the proponent's connection point or the fixed EG system(s)
- e. The GPR shall be connected as close to the connection point as practicable, referencing a single point beyond the connection point within the customer's installation
- f. The GPR reference point shall be connected at a location that has a lower impedance to the connection point than any EG unit connected within the customer's installation.

4.7.2.1 Grid reverse power protection

Grid reverse power protection requirements may be required for non-exporting EG systems, and include:

- a. Reverse power protection shall be set as low as practicable with consideration of protection relay, current transformer (CT) accuracy and generating system synchronisation characteristics
- b. The design of control systems shall minimise reverse power flow immediately following synchronisation
- c. Specific settings for grid reverse power protection shall be determined via a connection specific technical assessment.

4.7.2.2 Current unbalance protection

Current unbalance protection requirements for the EG system at the connection point shall include:

- a. The nominal inverter output rating of EG systems connected to multi-phase supply connections, shall not differ by more than 5 kVA between phases as a result of current unbalance. Phase balance protection shall respond to current unbalance by disconnecting all inverters within the IES automatically within 30 seconds via a method that complies with Clause 3.4.4.2 of AS/NZS 4777.1
- b. Where multiple single-phase inverters are used, they must be operated in accordance with Clause 8.2 of AS/NZS 4777.2, which requires that the AC output current is generated and injected into the three-phase connection as a three-phase balanced current.

Note that three phase IES which provide balanced output are exempt from this requirement.

4.7.2.3 Voltage unbalance protection

There are no voltage unbalance requirements for the EG system at the connection point.

4.7.2.4 Overcurrent facility fault, overcurrent grid fault and earth fault protection

Overcurrent facility fault, overcurrent grid fault and earth fault protection may be required for EG systems, and include:

- a. Overcurrent protection shall be provided at the IES isolating switch in accordance with the equipment rating
- b. Specific settings for overcurrent facility fault, overcurrent grid fault and earth fault protection shall be determined via a connection specific technical assessment.

4.7.2.5 Passive anti-islanding protection

Central anti-islanding protection shall be as per AS/NZS 4777.1 clause and replicated in Table 8 below.

Parameter	ANSI Code	Settings	Trip Delay Time	Disconnection time
Undervoltage 2 (V<<)	27P	70 V	1.5 s	2 s
Undervoltage 1 (V<)	27P	180 V	10.5 s	11 s
Overvoltage 1 (V>)	59P	265 V	1.5 s	2 s
Overvoltage 2 (V>>)	59P	275 V	0.1 s	0.2 s
Under-frequency (F<)	81U	47 Hz	1.5 s	2 s
Over-frequency (F>)	81O	52 Hz	0.1 s	0.2 s
Rate of change of frequency (ROCOF / df/dt)	81R	±4 Hz/s	0.3 s	0.5 s
Reconnect time	-	60 s	-	-

Table 8: Central voltage and frequency protection settings

4.7.2.6 Inter-tripping

There are no inter-tripping requirements.

4.7.3 Interlocking

The following interlocking requirements shall apply to EG systems:

- a. To mitigate unbalance conditions on the network, the IES shall be designed and installed to operate with balanced output across each phase as far as practical, as such a single-phase IES should not be used where the connection to the network is three-phase
- b. Where multiple single-phase inverters are connected to more than one phase, the inverters must be interlocked and configured to operate as an integrated multi-phase inverter providing a balanced output that is no more than 5 kVA between any phases as per AS/NZS 4777.1

- c. Three-phase inverters must be configured to ensure the maximum unbalance between phases is 5 kVA whilst connected to the network
- d. All three-phases of the inverters must simultaneously disconnect from, or connect to, the network in response to protection or automatic controls (e.g. anti-islanding trip and subsequent reconnection)
- e. Phase balance protection shall be as per 4.7.2.2. Inverters cannot be interlocked by internal controls. In these cases, the installation must be protected by a phase imbalance relay which must immediately isolate the inverter in the absence of reasonable balance between phases of 5 kVA as per Clause 3.4.4.2 of AS/NZS 4777.1. The inverters must be physically prevented from operating independently and all installed inverters must simultaneously disconnect from, or connect to, our distribution network in response to protection or automatic controls (e.g. anti-islanding trip and subsequent reconnection).

4.7.4 Power factor control

There are no power factor control requirements for the IES. Applicants looking to use their IES for site/load power factor control will be considered under negotiated technical conditions.

4.7.5 Synchronisation

When the system voltage has been restored on the distribution system side of the connection point, and the voltage and frequency have been maintained within protection limits for a period of no less than 60 seconds, the IES may reconnect.

The fixed EG system shall incorporate either automatic or operator-controlled equipment that ensures the frequency, voltages, and phase sequence of the fixed EG system is identical with (synchronised to) those in the distribution network before it connects to the distribution system. The fixed EG system shall not reconnect until it is synchronised with the distribution network.

4.8 Operating voltage and frequency

The inverter and customer installation must be designed, installed, and maintained in a manner that ensures that the maximum steady state voltage at any socket outlet or fixed equipment (other than the inverter) within the installation complies at all times with the requirements of AS/NZS 4777.1 and AS/NZS 4777.2.

4.8.1 Voltage rise

The proposed EG unit installation shall not cause more than 2% voltage rise at the point of supply. Voltage rise is calculated from the AC terminals of the inverter(s) to the point of supply as per AS/NZS 4777.1.

From Appendix C2 of AS/NZS 4777.1, the following shall be considered:

- a. An assessment of the consumer mains is required to ensure that the 2% voltage rise requirements of Clause 3.3.3 are able to be met with the intended IES rating
- b. It can be assumed that sizing an IES larger than the existing site load or energy use is likely to require additional work and costs to upgrade switchboards and possibly even the local grid.

Refer to figure C1 of AS/NZS 4777.1 for an example of application of voltage rise requirements for a typical EG installation.

4.8.2 Limits for sustained operation

4.8.2.1 Voltage

For sustained operation¹¹ for voltage variations, the maximum voltage set point shall be set as per the AS/NZS 4777.2 Region Australia A setting, without any variations as shown below in Table 9.

Reference	Setting
Sustained operation over-voltage limit (V_{nom_max})	258 V

Table 9: Limits for sustained operation for voltage variations

4.8.2.2 Frequency

For a grid disturbance that causes a change in grid frequency (outside of the continuous operation range), the inverter(s) shall respond as per AS/NZS 4777.2 Table 4.4 and Table 4.5 Region Australia A settings without any variations.

4.9 Metering

The installation shall meet metering requirements as per NT NER Chapter 7A and Power and Water NP010 Meter Manual¹², including replacement or re-configuration of existing meter(s) to bi-directional meter(s).

4.10 Power quality

4.10.1 Quality of supply

EG connections shall comply with the applicable power quality requirements of the AS/NZS 61000 series as well as the Power and Water Network Technical Code and Planning Criteria, including but not limited to:

- a. Network voltage control
- b. Voltage fluctuations
- c. Harmonics
- d. Voltage balance.

Power and Water may provide site specific power quality requirements during the connection enquiry.

4.10.2 IES Power quality response modes

The volt–var and volt–watt response modes specified in Clause 3.3.2.2, Clause 3.3.2.3 and Clause 3.4.2 of AS/NZS 4777.2 shall both be enabled and shall respond as per AS/NZS 4777.2 “Australia A” default settings, without any variations as shown below in Table 10 and Table 11.

¹¹ Sustained operation refers to a 10 minute average value which needs to be calculated for the preceding 10 minutes at least every 3 seconds based on measurements at the inverter’s terminals or another external measurement position for comparison with the V_{nom_max} to determine when to disconnect.

¹² Power and Water Design and construction guidelines, available from <https://www.powerwater.com.au/developers/power/design-and-construction-guidelines>

Reference	Voltage	Inverter reactive power level (Var % rated VA)
Volt-var 1 (Vv1)	207 V	44% leading
Volt-var 2 (Vv2)	220 V	0%
Volt-var 3 (Vv3)	240 V	0%
Volt-var 4 (Vv4)	258 V	60% lagging

Table 10: Volt-var response mode settings

Note: Lagging is when the EG unit absorbs reactive power from the network, and leading is when the EG unit acts as a source of reactive power into the network.

Reference	Voltage	Inverter maximum active power output level (P / P_{rated} , %)
Volt-watt 1 (Vw1)	253 V	100%
Volt-watt 2 (Vw2)	260 V	20%

Table 11: Volt-watt response mode settings

Note: Where P is the output power of the inverter and P_{rated} is the rated output power of the inverter.

4.10.3 Ramping Requirements

Ramping requirements and settings shall be as per AS/NZS 4777.2 default settings, with any variations marked with an asterisk (*) below in **Table 12** for inverters capable of use with energy storage (multiple mode operation). For such systems without an export limit, they shall be configured to operate in 'changes to energy source operation' mode.

Reference	Maximum Ramp rate	Nominal ramp time (Tn)
Rate limit an increase in power (W_{GRA+})	16.67 % per minute	6 minutes
Rate limit a decrease in power (W_{GRA-})	16.67 % per minute	6 minutes

Table 12: Ramping settings for inverters capable of use with energy storage

4.11 Communications systems

There are no requirements for communications systems for IES on a static export limit.

For IES with a dynamic export limit Power and Water will supply and manage a communications system (STA) between the local dynamic control device and the Power and Water systems.

4.12 Data and information

4.12.1 Static data and information

Static data and information that is required to be provided by the proponent to Power and Water is set out within **Appendix D: Static data and information**.

4.12.2 Dynamic data and information

There are no requirements for dynamic data and information for systems on a static export limit. Systems with a dynamic export limit will be required to provide real time data via the Power and Water provided gateway device. Details of the required data points will be defined during the application process.

4.13 Cyber security

The owner of the system is responsible for securing the IES from unauthorised external control and modification.

If Power and Water require remote monitoring and control of the IES then additional cyber security requirements will be advised by Power and Water.

The cyber security requirements for IES which have remote control capability installed shall ensure security against electronic intrusion and tampering by unauthorised parties through provisions, including (but not limited to):

- a. Monitoring and communications devices shall be in screw sealed or lockable enclosures
- b. Protection and control from network systems (e.g. firewalls and encrypted traffic)
- c. Privilege settings and password protection.

Power and Water is required to comply with the Australian Energy Sector Cyber Security Framework (AESCSF), which is legislated by the Australian government as part of the *Critical Infrastructure Act (2018)*. Specific compliance requirements including the type of equipment/settings to be used to interface with PWC SCADA and control systems will be provided during the application process.

4.14 Technical studies

Technical studies shall be undertaken and completed by Power and Water as part of the connection application and in accordance with jurisdictional requirements at the proponent's expense. Technical study requirements are set out below in Table 13.

Technical study	EG IES > 30kVA	
	Exporting (Full/Partial)	Non-exporting
Voltage level (including power factor)	✓	–
Power flow	✓	–
Fault level	–	–
Protection grading	–	–

Table 13: Technical study requirements

Symbols are used to denote technical study requirements, where:

- ✓ Represents that the technical study shall be required
- Represents that the technical study may be required
- × Represents that the technical study shall not be required

Where the technical study does not meet the assessment criteria, Power and Water shall provide the proponent with an alternative option, which may include:

- a. Alternative configurations of the generating systems (e.g. lower generation control limits)
- b. Network augmentation (and associated cost of network augmentation).

5 Fees and charges

Information regarding fees and charges applicable to proponents is available at the following link:

<https://www.powerwater.com.au/customers/moving-and-building/power-connections>

6 Testing and commissioning

Testing and commissioning requirements for EG IES connections include the following in addition to requirements provide in Table 14:

- Testing and commissioning plans shall be produced by the proponent. The signed off testing and commissioning plans shall be provided to Power and Water upon request
- Testing and commissioning acceptance may require Power and Water to carry out witnessing and may be charged at the proponent's expense
- On-site testing and commissioning shall be undertaken in accordance with AS/NZS 4777.1, AS/NZS 3000, AS/NZS 5033 (where applicable) and AS/NZS 5139 (where applicable), the equipment manufacturer's specifications, and this document to demonstrate that the EG system meets the requirements of the connection agreement
- The tests shall be installation tests and not type tests.

Testing and commissioning requirements	EG IES	
	Exporting	Non-exporting
Protection settings and performance	✓	✓
Power quality settings and performance	✓	✓
Export limits settings and performance including fallback settings (AS/NZS4777.1 clause 6.1)	✓	✓
Communications settings and performance	-	×
Shutdown Procedures	×	×
Confirm system is as per specifications	✓	✓
Confirm a suitable "As Built" Single Line Diagram is located on site	✓	✓

Table 14: Testing and commissioning requirements

Symbols are used to denote testing and commissioning requirements, where:

- ✓ Represents that the testing and commissioning shall be required
- Represents that the testing and commissioning may be required
- ×

Refer to the Power and Water embedded generation commissioning form, available at the following link:

<https://www.powerwater.com.au/customers/moving-and-building/power-connections>

7 Operations and maintenance

Operations and maintenance requirements for EG connections include:

- a. An operation and maintenance plan shall be produced, and signed off by the proponent's suitably qualified engineer prior to forming a connection agreement. A copy shall be left on site, and the signed off operation and maintenance plan shall be provided to Power and Water upon request
- b. The EG system shall be operated and maintained to ensure compliance with the connection agreement and all legislation, codes, and/or other regulatory instruments at all times
- c. Operation and maintenance reports shall be submitted to Power and Water upon request, no more frequently than annually
- d. Power and Water may inspect and test the proponent's EG system at any time at Power and Water's cost. Should the inspection identify non-compliance with this technical requirements document, the EG system may be disconnected from Power and Water's network. The EG system will not be reconnected to the network until Power and Water is satisfied that the non-compliance has been resolved. Rectification of non-compliance issues shall be at the proponent's cost.

The general expectations for operating and maintaining the EG systems shall include:

- a. Maintaining the electrical installation at the supply address in a safe condition
- b. Ensuring that any changes to the electrical installation at the supply address are performed by an electrician lawfully permitted to do the work and that the proponent holds a Certificate of Compliance issued in respect of any of the changes
- c. The proponent shall seek Power and Water's approval prior to altering the connection in terms of an addition, upgrade, extension, expansion, augmentation or any other kind of alteration, including changing inverter settings.

Appendix A: Deviations from the national DER connection guidelines

Section	ENA National DER Connection Guidelines for LV EG Connections requirements	Description of deviation	Type of deviation	Justification
1.2	Inclusion of non-IES	Exclusion of non-IES	N/A	Non IES systems covered in separate standard
2.3.1	Subcategories shall include - LV EG IES (excluding BESS) connection ≤200 kVA, - LV EG IES (excluding BESS) connection >200 kVA, and - LV EG non-IES connection	No subcategory with standard to include all systems considered a 'Small Generating System'	Jurisdictional requirement	Consistency with Power and Water requirements to ensure system security
4.2	Applies at the connection point only	In circumstances where there are multiple connection points on a single lot, the system capacity (3.4) and export limit (3.5) will apply on a per lot basis	Jurisdictional requirement	Consistency with Power and Water requirements
4.3.2	Requires a subsection heading to be retained for Site generation limit downstream of connection point	This subheading has been removed from the document and 'additional export limits' section added	N/A	Consistency with Power and Water requirements
4.6	For BESS, earthing requirements shall be as per AS/NZS 3011	For BESS, earthing requirements shall be as per AS/NZS 5139	Compliance with relevant standards	The new standard AS 5139 is directly applicable for use of IES with BESS
4.7.1, 4.7.2.4	As per AS/NZS 4777.2 default settings	Updated to AS/NZS 4777.2:2020 Australia Region Australia A Settings.	Promote improved benefits to the electricity system	Consistency with Power and Water requirements

Section	ENA National DER Connection Guidelines for LV EG Connections requirements	Description of deviation	Type of deviation	Justification
4.7.2, 4.7.2.1	Grid reverse power (32R) shall be required for exporting EG systems	Grid reverse power (32R) protection is not required for exporting EG systems ≤ 200 kVA	Promote improved benefits to the electricity system	Export considered a 'soft' limit
4.7.2, 4.7.2.3	Overcurrent facility fault, grid fault and earth fault protection (50/51) shall be required for all EG systems	Overcurrent facility fault, grid fault and earth fault protection (50/51) is not required for IES	Promote improved benefits to the electricity system	Consistency with Power and Water requirements
4.7.6, 4.10.3, 4.11.3	Sections relating to LV EG Non-IES	These sections are excluded from the document	Promote improved benefits to the electricity system	Non IES EG covered via separate standards.
4.8	As per AS/NZS 4777.2 default settings	Updated to AS/NZS 4777.2:2020 Australia Region Australia A Settings.	Promote improved benefits to the electricity system	Consistency with Power and Water requirements
4.10.2	Volt-var settings are as per AS/NZS 4777.2 Vv3 = 250V, 30% leading Vv4 = 265V, 30% lagging	Vv1 = 207V, 44% leading Vv4 = 258V, 60% lagging	Aligned with Region Australia A under AS/NZS 4777:2020	Align with AS/NZS 4777:2020
4.10.2	Volt-watt settings are as per AS/NZS 4777.2 Vw3 = 250V Vw4 = 265V	Vw3 = 253V Vw4 = 260V	Promote improved benefits to the electricity system	Align with AS/NZS 4777:2020
4.11	Communications systems requirements may be recommended	Addition of Dynamic Export communications requirements	Promote improved benefits to the electricity system	Provide for system security benefits

Table 15: Table of Deviations from National DER Connection Guidelines

Appendix B: Connection arrangement requirements

B1 Single line diagram

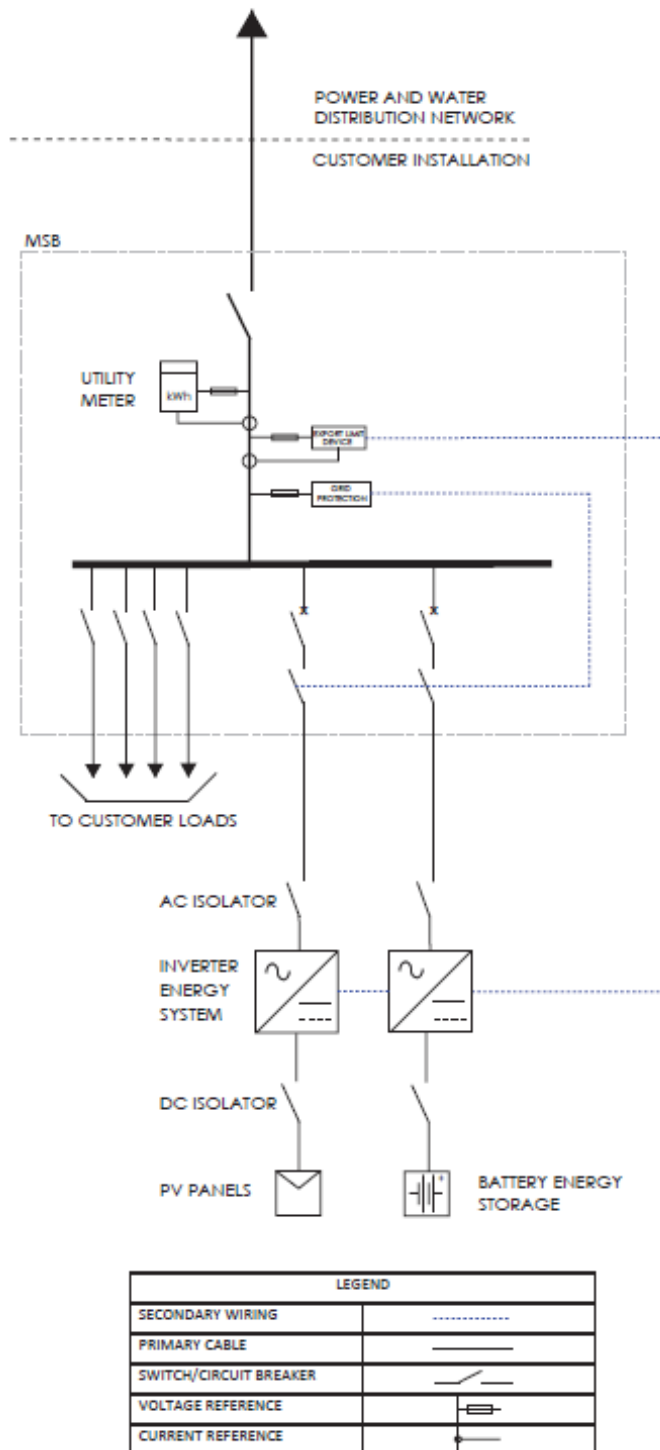


Figure 1: Typical single line diagram for an EG system

Appendix C: Connection agreement

The connection agreement template for negotiated EG connections is available at the following link:

Negotiated contracts:

<https://www.powerwater.com.au/customers/moving-and-building/power-connections>

Appendix D: Static data and information

The static data and information that is required to be provided by the proponent to Power and Water is to be provided via the Power and Water embedded generation commissioning form, available at the following link:

<https://www.powerwater.com.au/customers/moving-and-building/power-connections>

Contact

Power and Water Corporation
Phone 1800 245 092
powerwater.com.au

PowerWater 