


3RD ANGLE — DO NOT SCALE — REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

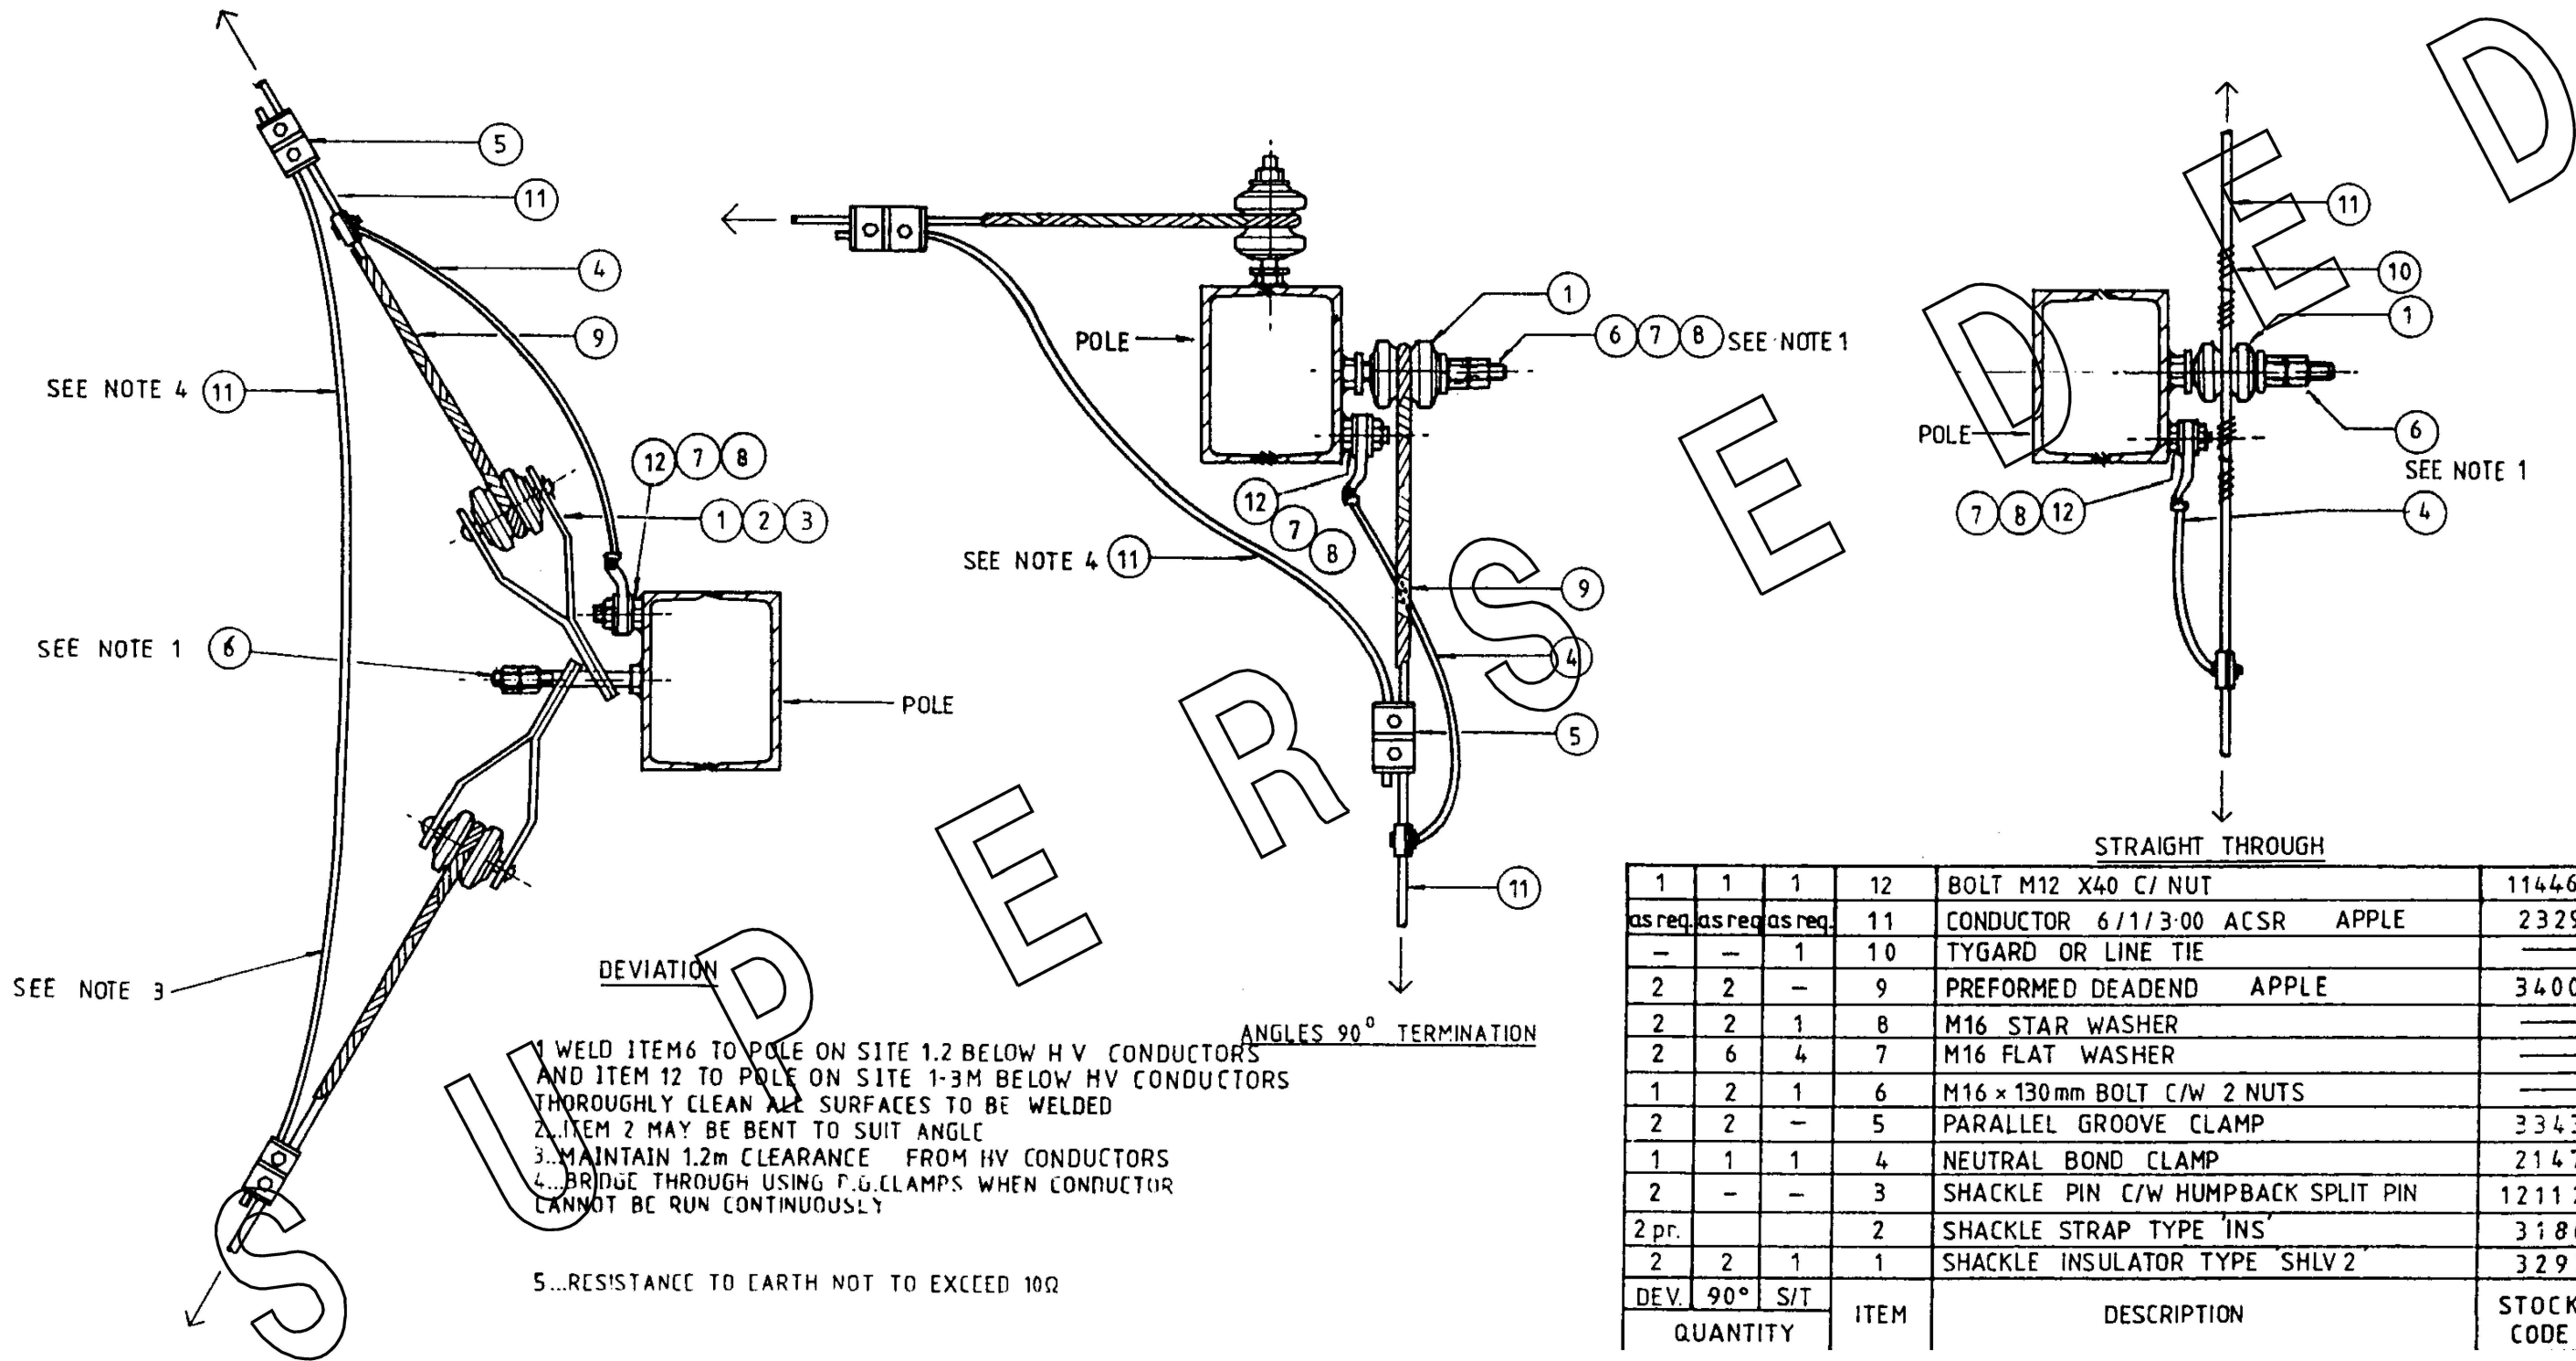

1 WELD ITEM 6 TO POLE ON SITE 1.2M BELOW HV CONDUCTORS AND ITEM 12 TO POLE ON SITE 1-3M BELOW HV CONDUCTORS
 THOROUGHLY CLEAN ALL SURFACES TO BE WELDED
 2. ITEM 2 MAY BE BENT TO SUIT ANGLE
 3. MAINTAIN 1.2m CLEARANCE FROM HV CONDUCTORS
 4. BRIDGE THROUGH USING P.G. CLAMPS WHEN CONDUCTOR CANNOT BE RUN CONTINUOUSLY
 5. RESISTANCE TO EARTH NOT TO EXCEED 10Ω

1	1	1	12	BOLT M12 X40 C/ NUT	114462
as req.	as req.	as req.	11	CONDUCTOR 6/1/3-00 ACSR APPLE	2329
-	-	1	10	TYGARD OR LINE TIE	---
2	2	-	9	PREFORMED DEADEND APPLE	3400
2	2	1	8	M16 STAR WASHER	---
2	6	4	7	M16 FLAT WASHER	---
1	2	1	6	M16 x 130mm BOLT C/W 2 NUTS	---
2	2	-	5	PARALLEL GROOVE CLAMP	3343
1	1	1	4	NEUTRAL BOND CLAMP	2147
2	-	-	3	SHACKLE PIN C/W HUMPBACK SPLIT PIN	12112
2 pr.	-	-	2	SHACKLE STRAP TYPE 'INS'	3186
2	2	1	1	SHACKLE INSULATOR TYPE 'SHLV 2'	3293
DEV. 90°	S/T		ITEM	DESCRIPTION	STOCK CODE
QUANTITY					

5	TITLEBLOCK & DRAWING NUMBER FORMATTED	K.T.	APR'19	C.C.	C.C.
4	NOTES AMENDED	-	13/2/92	gmck	N.S.
3	EARTHING BOND AMENDED	-	5/8/91	D.S.	N.S.
2	STOCK CODES ADDED	-	14/11/88	H.T.	G.S.
1	TITLE & NUMBER CHANGED	-	08/87	W.T.	-
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					



DES	G. BRAND	POWER STANDARD DRAWING		
DRN	R. HAIGH	EARTHING HV AERIAL EARTH		
CKD	-	DRAWING NUMBER S01-02-03-01		
APPD	-	5		
SCALE	N.T.S.	AMDT		
ISSUED	10/12/80	DRAFTING STANDARD TO A.S.1100		
ALL DIM.	IN mm	CAD PRODUCT - DO NOT AMEND MANUALLY		