
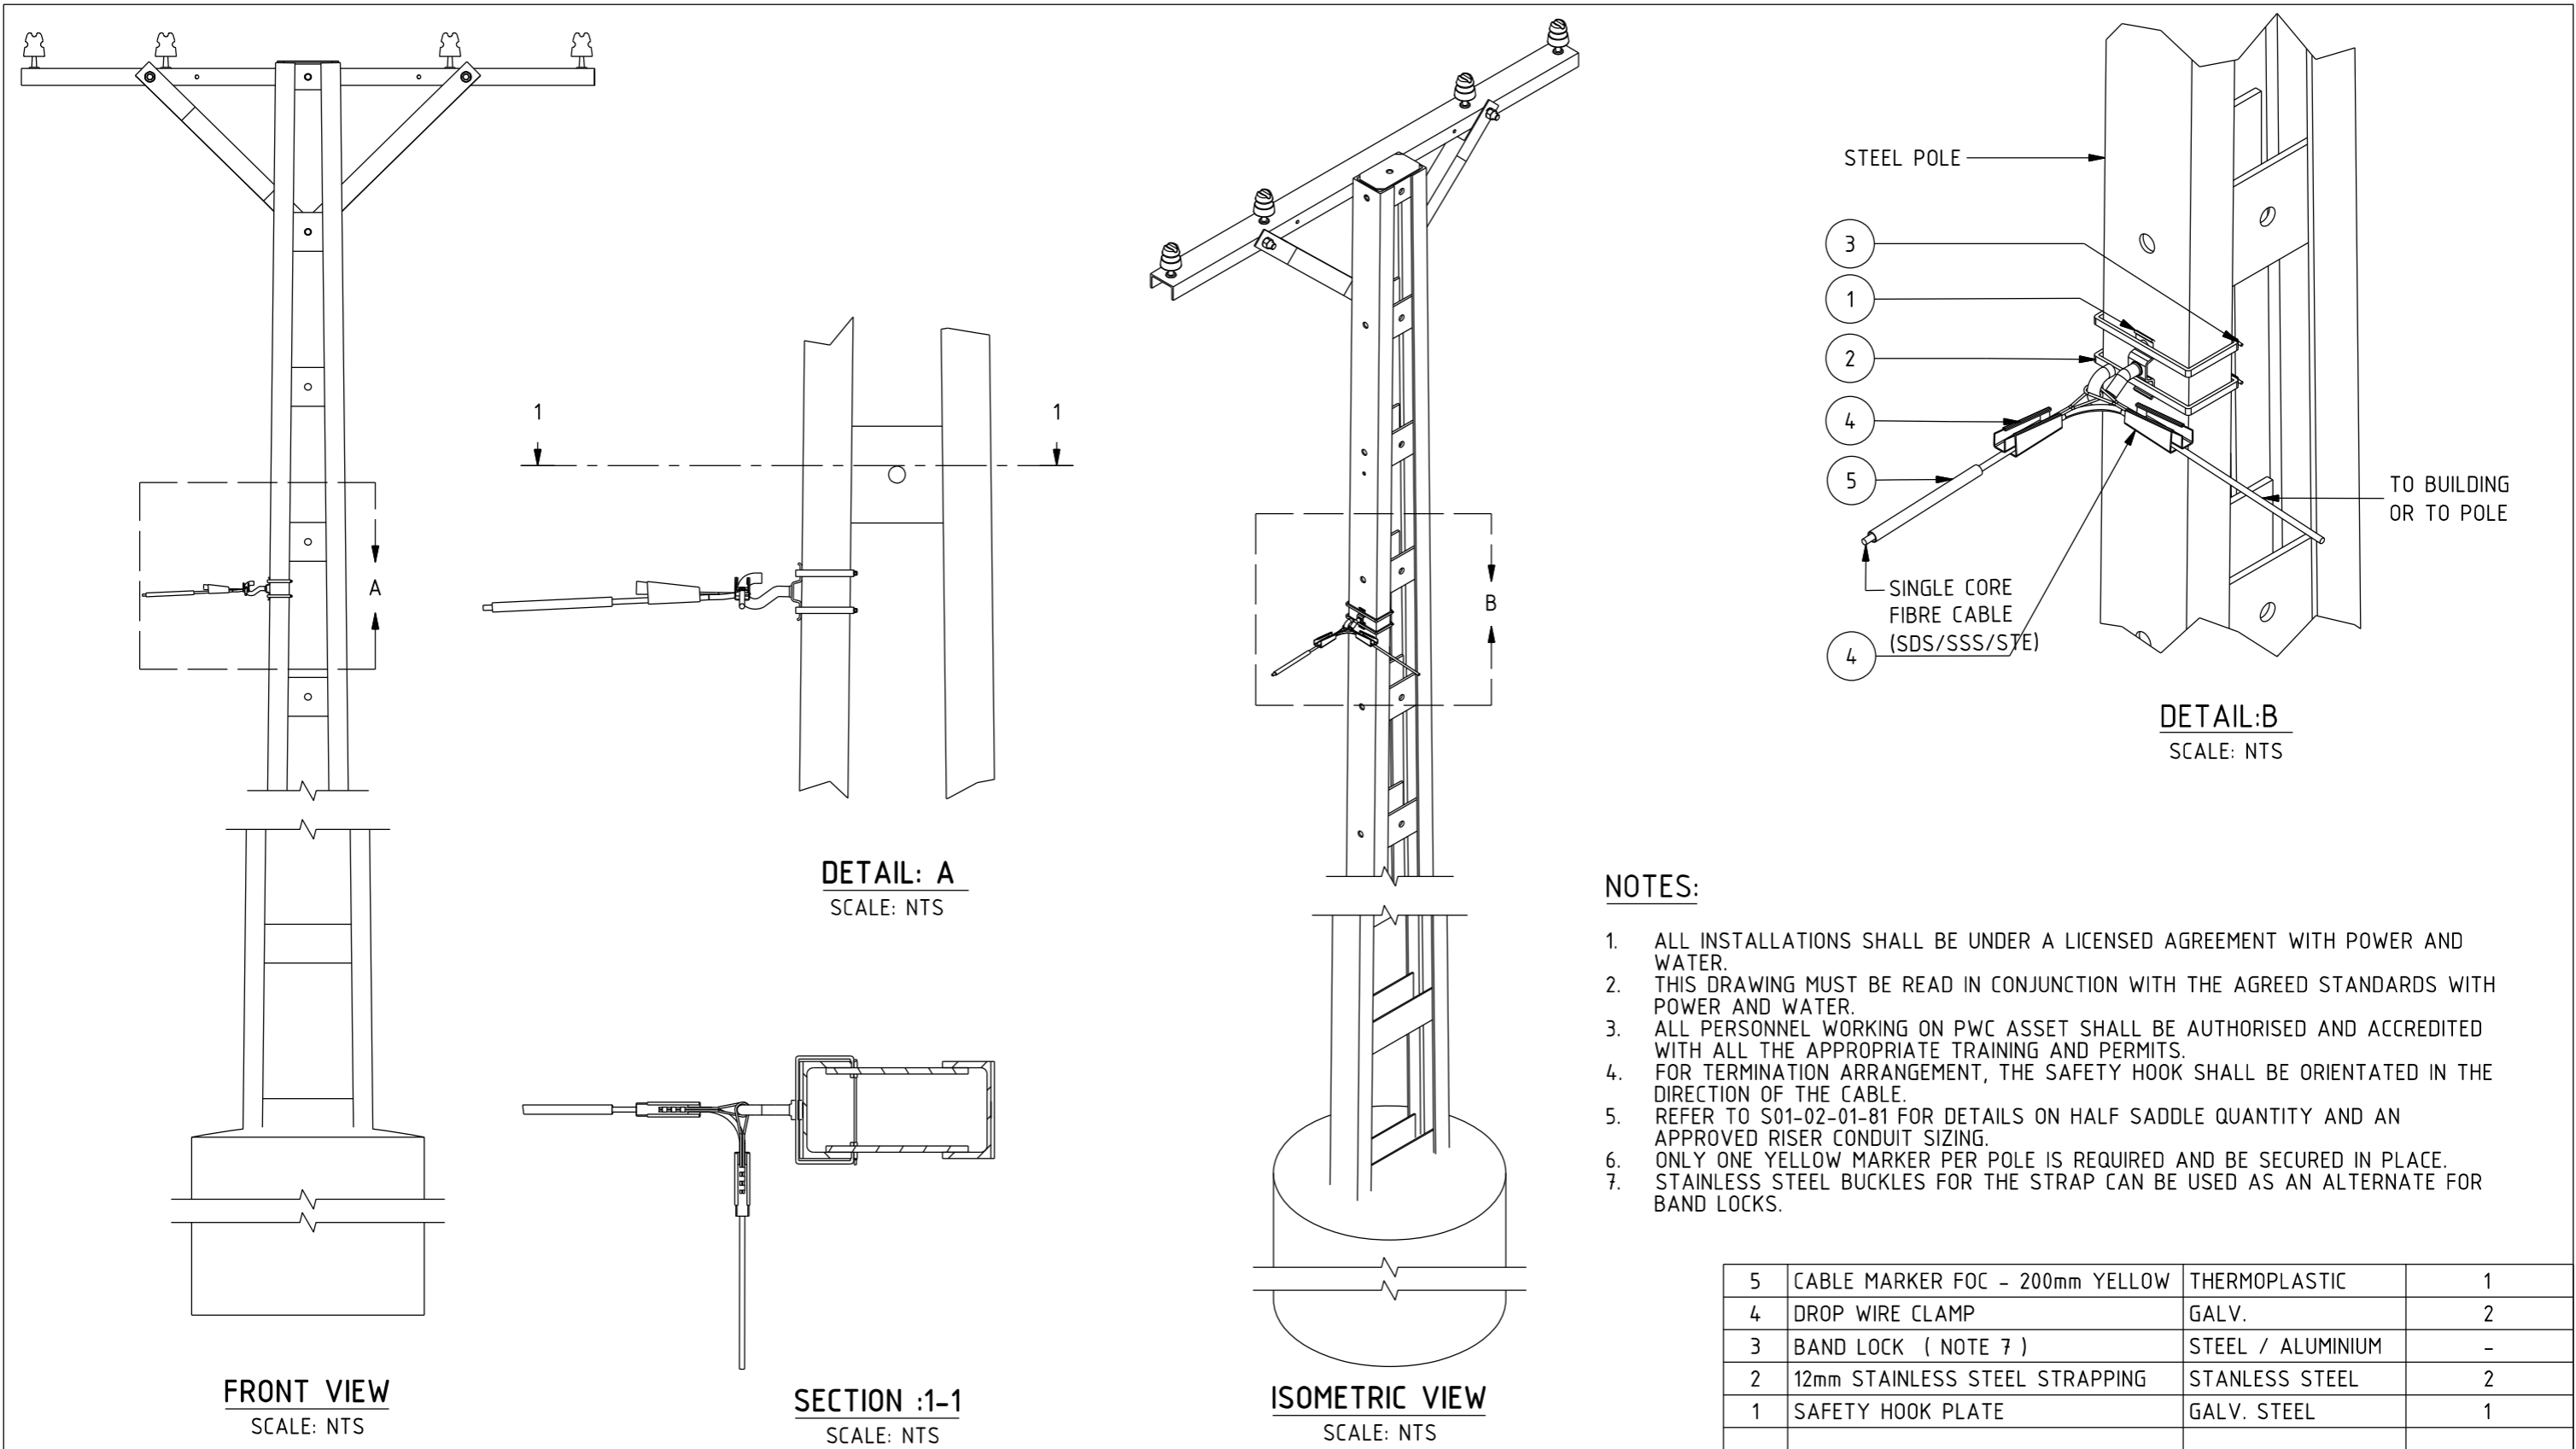




DES	P.BHATTARAI	POWER STANDARD DRAWING			
DRN	P.GUNA	COMMUNICATIONS SERVICE PROVIDER (CSP) DROP WIRE SAFETY HOOK CLAMP INSTALLATION - STRAIGHT THROUGH SHEET 1 OF 3			
CKD	B.VANDERSTELT				
APPD	P.BHATTARAI				
SCALE	NTS				
ISSUED	JUL'24				
ALL DIM. IN mm		A3	DRAWING NUMBER	S01-02-01-80_1	
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY			AMD

0	ISSUED FOR CONSTRUCTION	P.G.	JUL'24	B.V.	P.Bh
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					






ANGLE CSP CABLE TERMINATION ARRANGEMENT


0	ISSUED FOR CONSTRUCTION	P.G.	JUL'24	B.V.	P.Bh.
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					




5	CABLE MARKER FOC - 200mm YELLOW	THERMOPLASTIC	1
4	DROP WIRE CLAMP	GALV.	2
3	BAND LOCK (NOTE 7)	STEEL / ALUMINIUM	-
2	12mm STAINLESS STEEL STRAPPING	STANLESS STEEL	2
1	SAFETY HOOK PLATE	GALV. STEEL	1
ITEM	DESCRIPTION	MATERIAL	QTY
MATERIALS SCHEDULE			
DES	P.BHATTARAI	POWER STANDARD DRAWING	
DRN	P.GUNA	COMMUNICATIONS SERVICE PROVIDER (CSP)	
CKD	B.VANDERSTELT	DROP WIRE SAFETY HOOK CLAMP	
APPD	P.BHATTARAI	INSTALLATION - DEVIATION	
SCALE	NTS	SHEET 2 OF 3	
ISSUED	JUL'24	A3	DRAWING NUMBER S01-02-01-80_2
ALL DIM. IN mm			
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY	
			0 AMDT

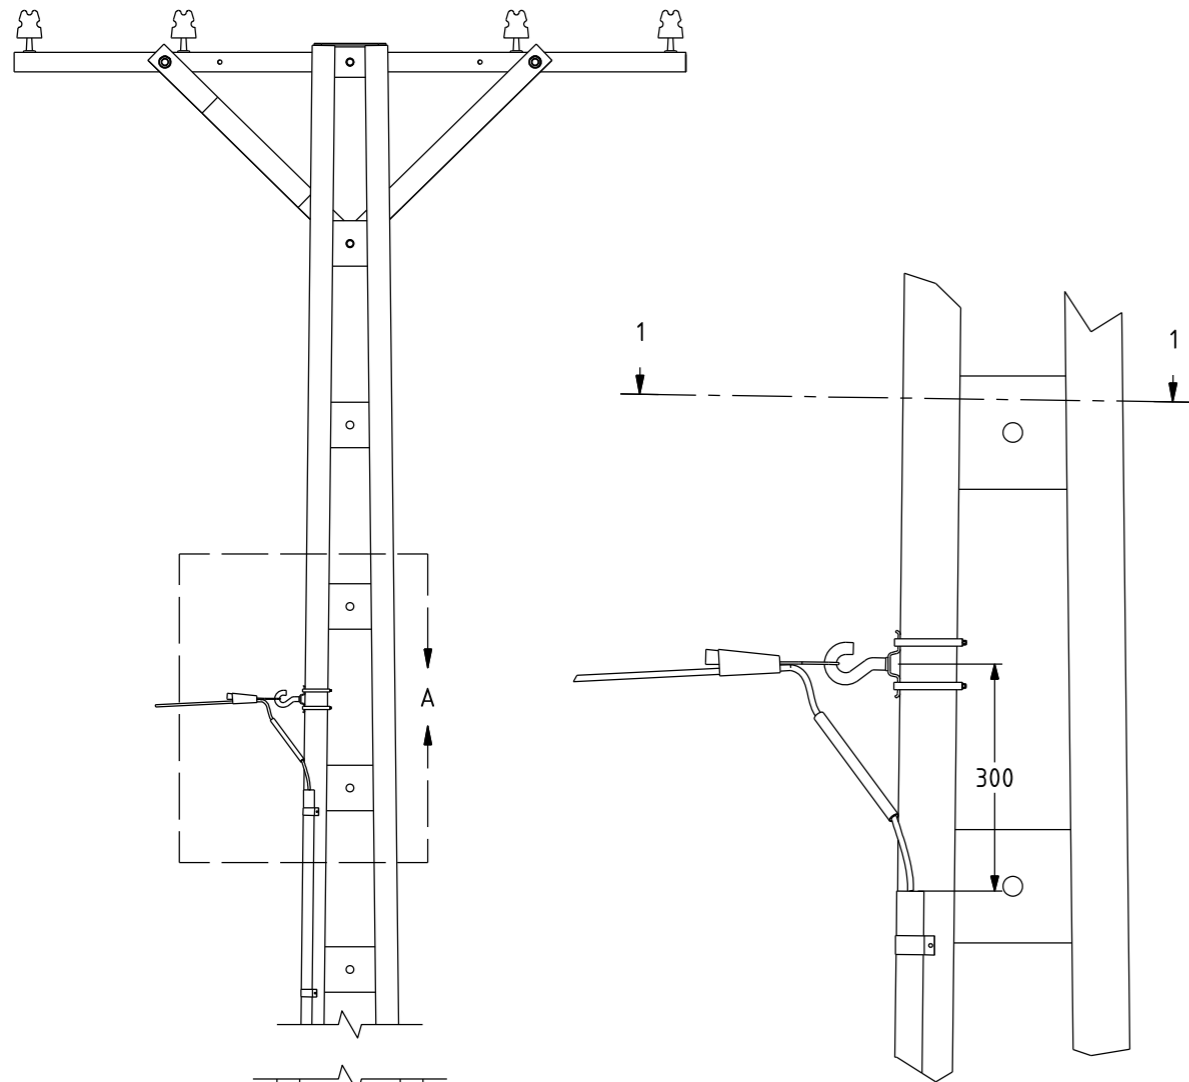


DETAIL: A
SCALE: NTS

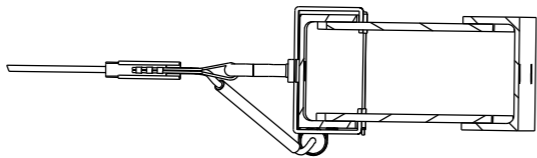

SECTION : 1-1
SCALE: NTS

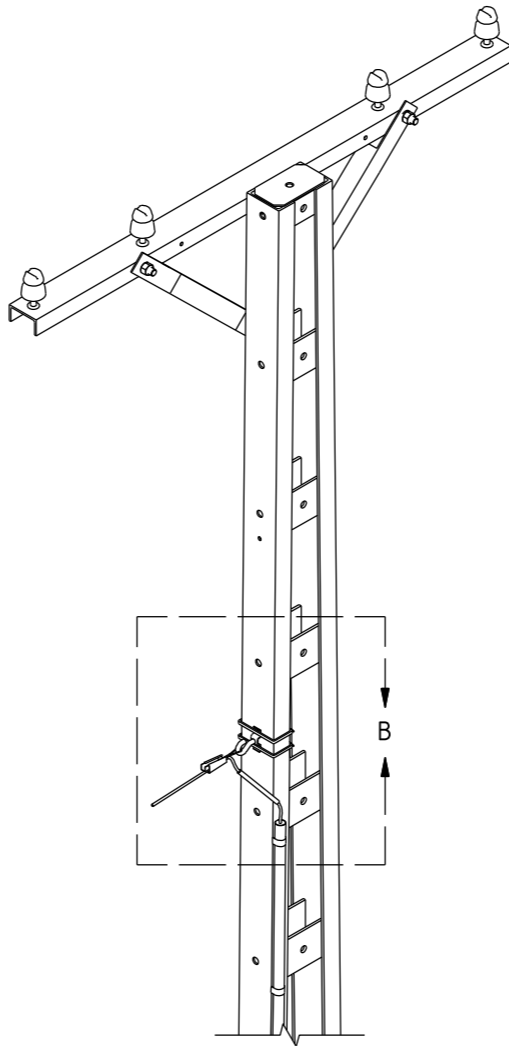

ISOMETRIC VIEW
SCALE: NTS

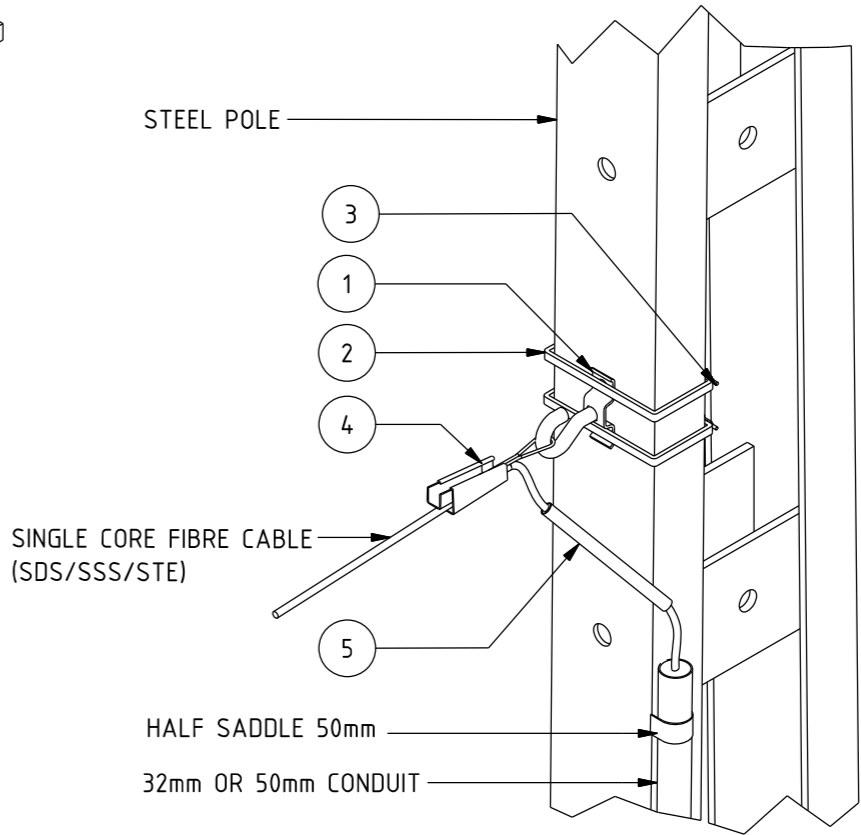


DETAIL: B
SCALE: NTS

NOTES:

1. ALL INSTALLATIONS SHALL BE UNDER A LICENSED AGREEMENT WITH POWER AND WATER.
2. THIS DRAWING MUST BE READ IN CONJUNCTION WITH THE AGREED STANDARDS WITH POWER AND WATER.
3. ALL PERSONNEL WORKING ON PWC ASSET SHALL BE AUTHORISED AND ACCREDITED WITH ALL THE APPROPRIATE TRAINING AND PERMITS.
4. USE ROUND RISER CONDUIT FOR UGOH SERVICE (SDS/SSS/STE) CABLE.
5. ONLY ONE YELLOW MARKER PER POLE IS REQUIRED AND SECURED IN PLACE.
6. STAINLESS STEEL BUCKLES FOR THE STRAP CAN BE USED AS AN ALTERNATE FOR BAND LOCKS.

5	CABLE MARKER FOC - 200mm YELLOW	THERMOPLASTIC	1
4	DROP WIRE CLAMP (TE)	GALV.	1
3	BAND LOCK (NOTE 6)	STEEL / ALUMINIUM	-
2	12mm STAINLESS STEEL STRAPPING	STAINLESS STEEL	2
1	SAFETY HOOK PLATE	GALV.STEEL	1
ITEM	DESCRIPTION	MATERIAL	QTY

MATERIALS SCHEDULE

DES	P.BHATTARAI	POWER STANDARD DRAWING			
DRN	P.GUNA	COMMUNICATIONS SERVICE PROVIDER (CSP) DROP WIRE SAFETY HOOK CLAMP INSTALLATION - UGOH SHEET 3 OF 3			
CKD	B.VANDERSTELT				
APPD	P.BHATTARAI				
SCALE	NTS				
ISSUED	JUL'24	A3	DRAWING NUMBER	S01-02-01-80_3	
ALL DIM. IN	mm				
DRAFTING STANDARD TO A.S.1100			CAD PRODUCT - DO NOT AMEND MANUALLY		AMDT

UGOH CSP CABLE TERMINATION ARRANGEMENT

0		ISSUED FOR CONSTRUCTION	P.G.	JUL'24	B.V.	P.Bh.
NO		DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS						

