



SPECIAL CRITERIA FOR NT PUBLIC LIGHTING LANTERNS :

1. DELETION OF BUILT-IN FUSE WITHIN LANTERN.
2. PROVISION OF REMOVABLE GEAR TRAY.
3. PROVISION OF QUICK DISCONNECT PLUGS BETWEEN BASE AND REMOVABLE TRAY. (SIMILAR TO UTILUX M/N 1542-2).
4. EARTH ATTACHMENT TO BODY OF LANTERN.
5. LANTERN TO COMPLY WITH AS 3171 FOR CATEGORY 'P' ROAD LUMINAIRES.

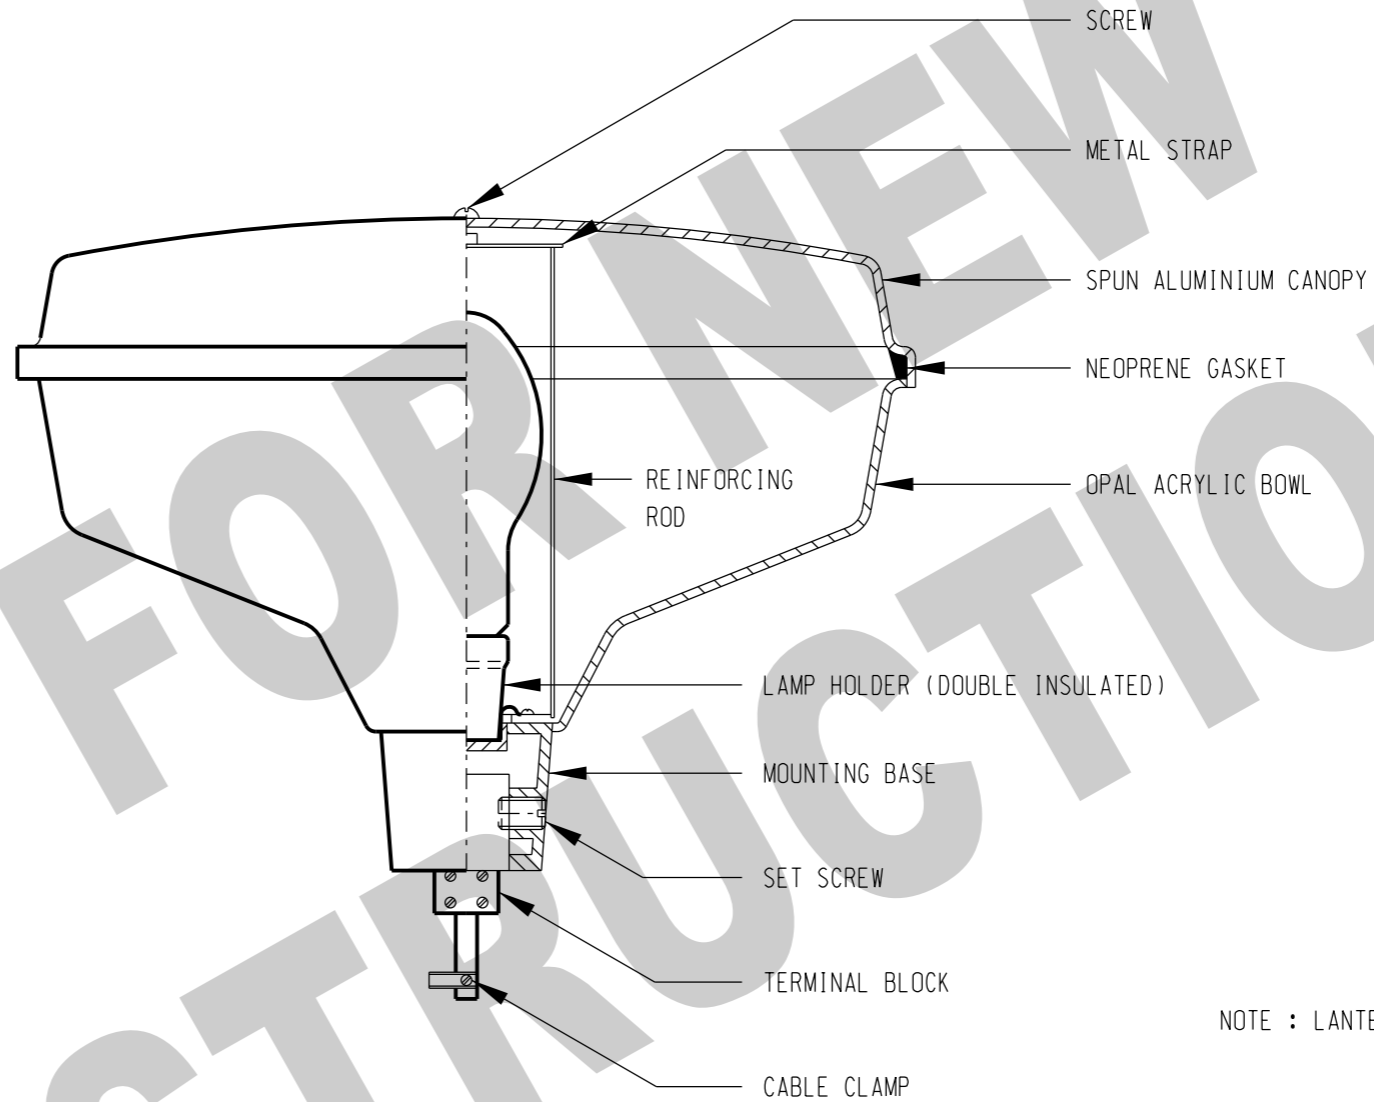

NOTE : LANTERN SUPPLIED LESS LAMP

3	LAMP (80W)	10389	-
2	BOWL	7104	-
1	COMPLETE FITTING	11718	Z5682
ITEM No	DESCRIPTION	ITEM NUMBER	GEC CAT.No.

						DES	-	POWER STANDARD DRAWING			
						DRN	A.SCHMID	LANTERN & LAMPS			
						CKD	F.ROBSON	MINOR ROADS			
						APPD	F.ROBSON	INTEGRAL-MERCURY VAPOUR 80-125W			
						SCALE	N.T.S.	POST TOP TYPE			
						ISSUED	FEB'02	A3	DRAWING NUMBER	S03-01-04-03	7 AMDT
						ALL DIM.	IN mm				
						DRAFTING STANDARD TO A.S.1100			CAD PRODUCT - DO NOT AMEND MANUALLY		
7	SET TO 'NOT FOR NEW CONSTRUCTION'. CHANGED 'STOCK CODE' TO 'ITEM NUMBER'	A.N.	AUG'21	C.C.C.	B.V.	 NORTHERN TERRITORY					
6	TITLEBLOCK & DRAWING NUMBER FORMATTED	K.T.	FEB'19	C.C.	C.C.						
5	RE-DRAWN IN CAD	W.T.	APR'02	F.R.R.	F.R.R.						
NO	DESCRIPTION	DRN	DATE	CKD	APPD						
AMENDMENTS											