


ITEM	ITEM NUMBER	DESCRIPTION	R.T.E. CAT. NO
1	8235	LOAD BREAK ELBOW KIT 35mm2	2604600B42M
2	412441	LOAD BREAK ELBOW KIT 95mm2	2604600B50M

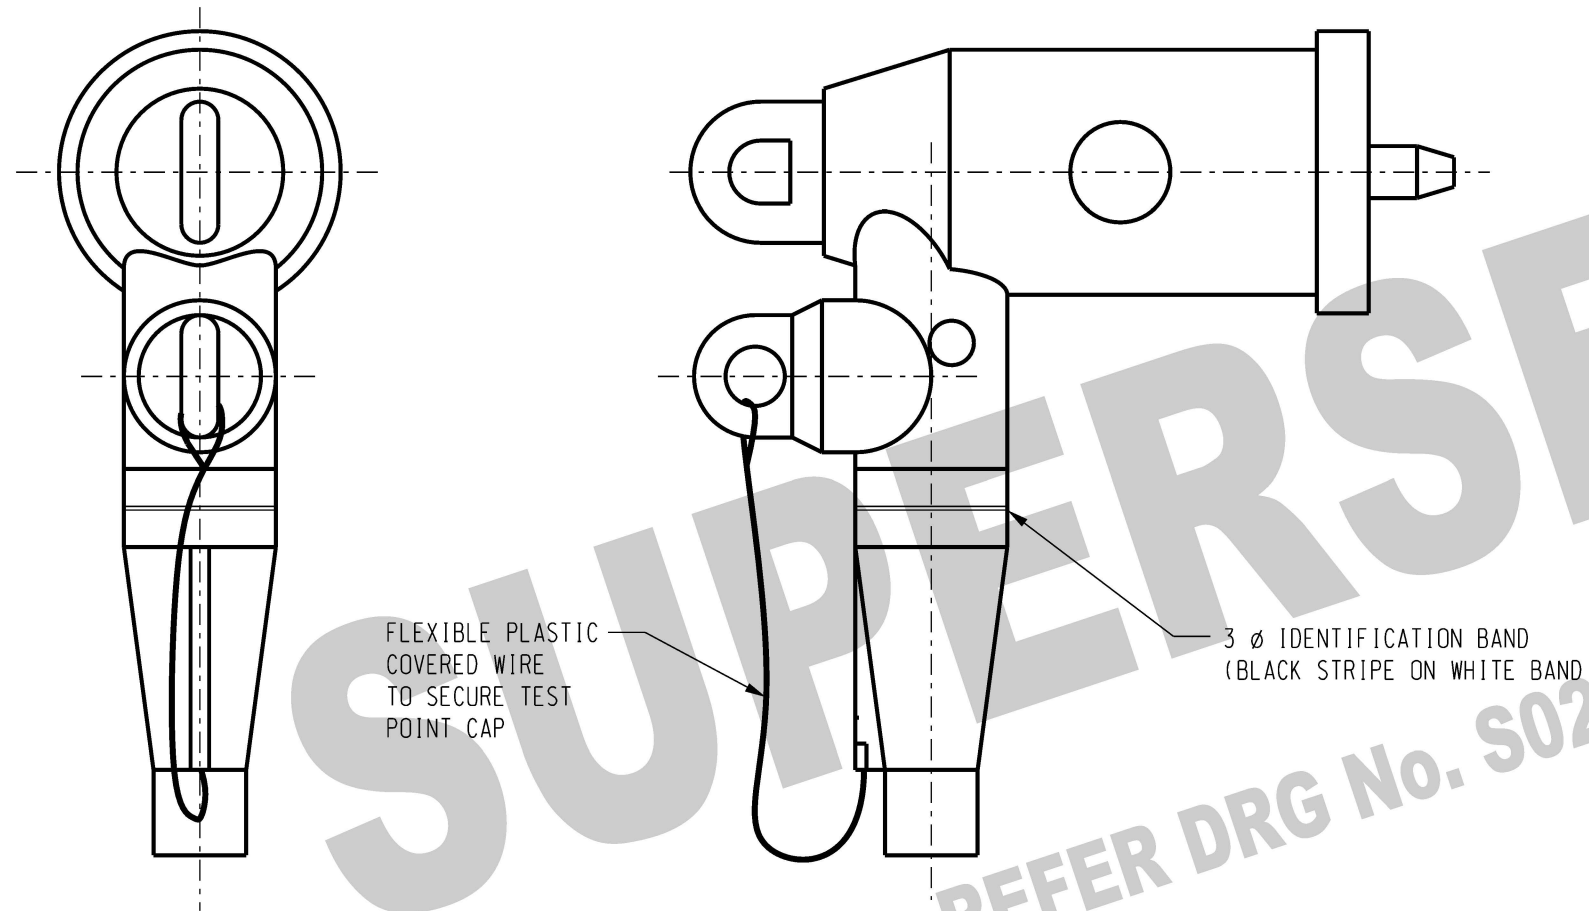

R.T.E. KIT COMPRISES THE FOLLOWING ITEMS:

DESCRIPTION OF PARTS	R.T.E. CAT. NO	
	35mm2	95mm2
1. MOULDED RUBBER INSULATING ELBOW	2601124C	2601124C
2. MALE CONTACT PROBE	2625345A03	2625345A03
3. COMPRESSION TYPE WIRE CONNECTOR	2609459A03	2609459A08
4. CONTACT PROBE INSTALLING WRENCH	2602733A01	2602733A01
5. CAPSULE OF SILICONE GREASE	2603393A01	2603393A01
6. CABLE STRIPPING TEMPLATE	50-00031006	50-00031006
7. COMPLETE INSTRUCTION SHEET	50-00050181	50-00050181

R.T.E. SBT IV WITH TEST POINT ILLUSTRATED

**NOTES:**

1. TERMINATION INSTRUCTIONS FOR 11kV, XLPE CABLE REFER DRG NO S02-02-02-05
2. 15kV CLASS 83/144kV  $\phi$ - $\phi$ , 3 $\phi$
3. ELBOWS TO BE IN ACCORDANCE WITH AS2629

NO	DESCRIPTION	DRN	DATE	CKD	APPD
10	UPDATE WATERMARK & AMEND ITEM NUMBER	C.C.	MAY'20	B.V.	B.V.
9	SUPERSEDED	A.T.	DEC'12	B.C.	B.C.
8	REDRAWN FOR USTATION, PART NUMBERS CHANGED.	RGI	09.96	AGB	PJD
7	TITLE AND DRAWING NUMBER CHANGED		05.88	...	...
6	STOCK CODES CORRECTED		03.87	...	...
5	ITEMS AND STOCK CODES ADDED		01.87	...	...
4	REDRAW AND REVISED		01.85	...	...

AMENDMENTS

**PowerWater**  
NORTHERN TERRITORY

DES	R.HAIGH	POWER STANDARD DRAWING		
DRN	S.SANDERS	<b>FUSES AND SWITCHGEAR LOAD BREAK ELBOW 11kV</b>		
CKD	G.McSHANAG			
APPD	I.CUK			
SCALE	NTS			
ISSUED	04/02/86	A3	DRAWING NUMBER	S02-01-04-04
ALL DIM.	IN mm			
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		AMDT