
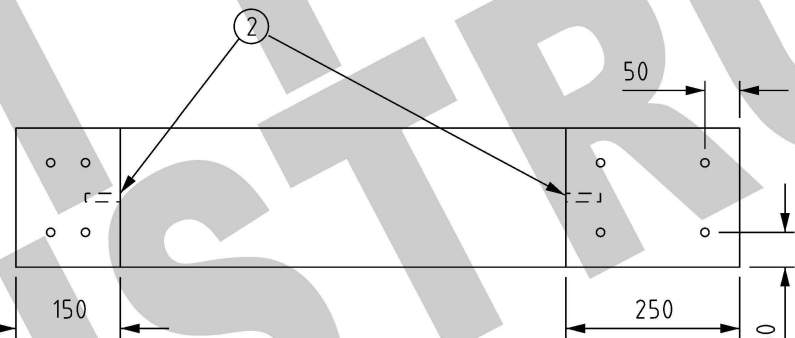
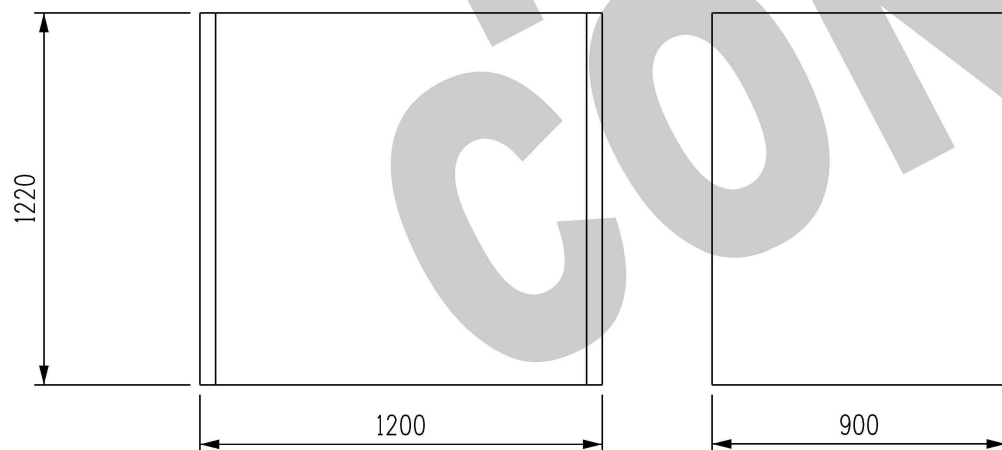




3	2	M12 FERRULES WITH 75X75X10 STAINLESS STEEL PLATE
2	4	M10 FERRULES TO SUIT M10 x 50 BOLT
1	8	N12 BARS WITH 300 COG AS NEEDED
ITEM	QTY	DESCRIPTION
MATERIAL SCHEDULE		

ITEM 1: DRIESCHER PRECAST SLAB
ITEM NUMBER : 502457

VOLUME: 0.18 m³
WEIGHT: 432 kg

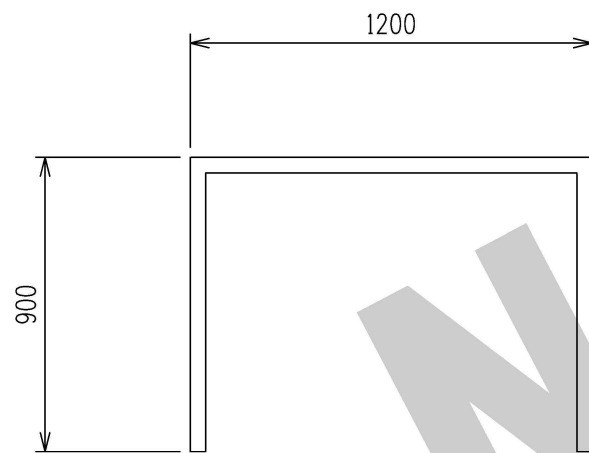

SECTION 2
NOT TO SCALE

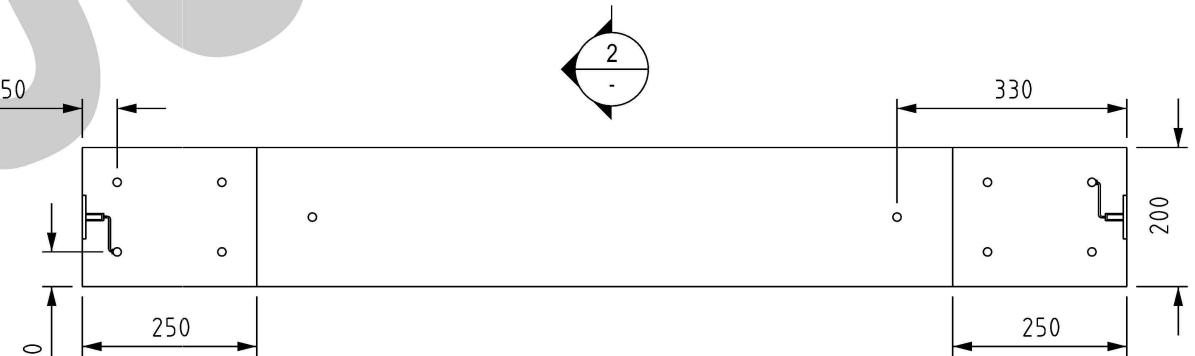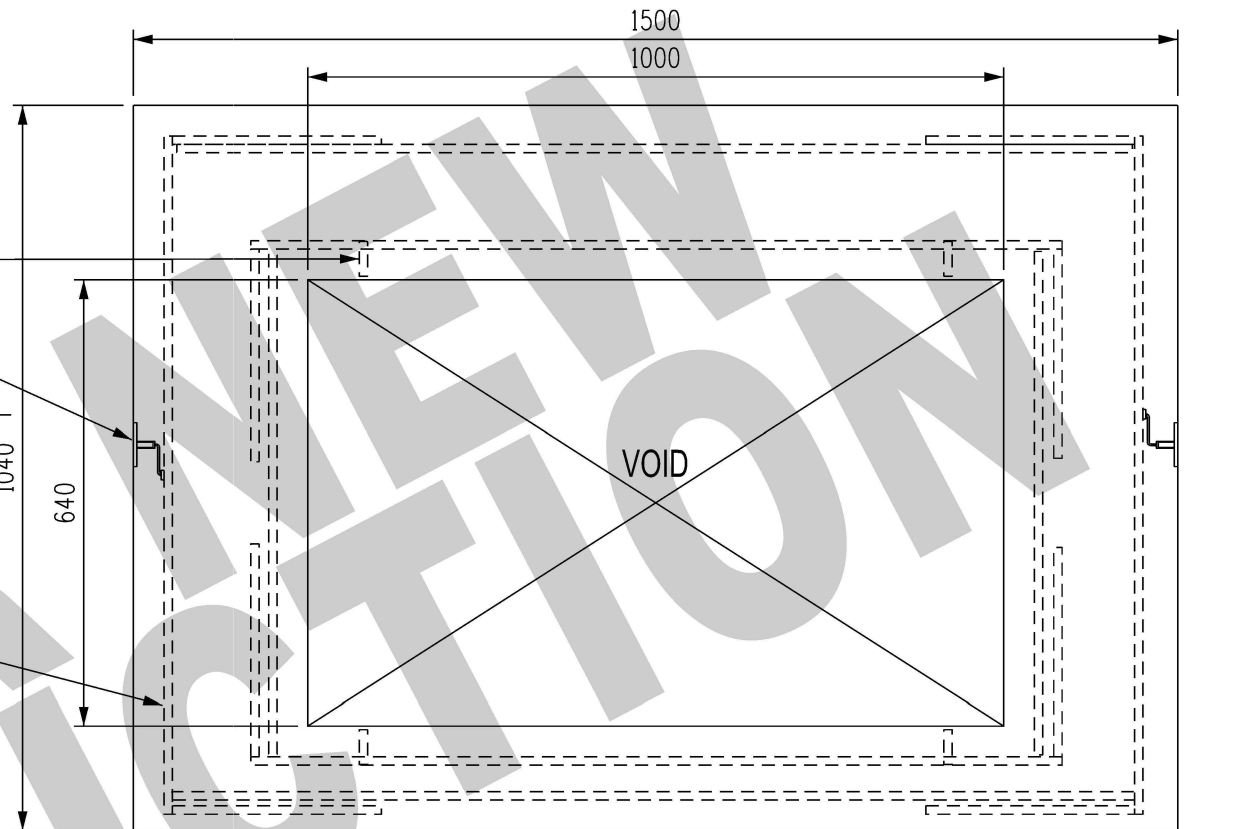

SECTION 1
NOT TO SCALE

NOTES:

- ATTACH NEW TOP SLAB TO EXISTING VAULT AS REQUIRED.
- USE CONCRETE STRENGTH N40.
- COMPLY WITH AS3600 AND AS1379.
- PROVIDE 45mm COVER TO REINFORCEMENT UNLESS NOTED OTHERWISE.
- REINFORCEMENT TO BE D500N BARS TO AS4671.
- CHAMFER EXTERNAL CORNERS AND FILLET RE-ENTRANT CORNERS 20x20.
- DO NOT LIFT PANEL UNTIL CONCRETE STRENGTH EXCEEDS 20MPa.
- NOMINAL INTERNAL DIAMETER OF COGS SHALL BE 5db WITH 120mm STRAIGHT EXTENSION.
- FABRICATION TO BE DONE IN ACCORDANCE WITH PWC SPECIFICATION STSP 02-001
- M12 EARTHING POINTS TO BE AS PER STSP 02-001

					 NORTHERN TERRITORY		DES C.CAMILLERI DRN R.ARSHAD CKD C.CAMILLERI APPD B.VANDERSTELT SCALE NTS ISSUED SEP'21 ALL DIM. IN mm		POWER STANDARD DRAWING PRECAST CONCRETE, FOUNDATION, RMU DRIESCHER MINEX-C		A3 DRAWING NUMBER S02-01-05-15	 AMDT
0	ISSUED STANDARD DRAWING	R.A.	SEP'21	C.C.C.	B.V.	DRAFTING STANDARD TO A.S.1100 CAD PRODUCT - DO NOT AMEND MANUALLY						
NO	DESCRIPTION	DRN	DATE	CKD	APPD	AMENDMENTS						