



3D VIEW
N.T.S.



ITEM	QTY	DESCRIPTION
9	4	1.3T FOOT ANCHOR (GALVANISED OR STAINLESS STEEL)
8	2	M12 FERRULES & 75x75x10 SQUARE PLATE (STAINLESS STEEL)
7	2	SL82 MESH (600 x 2000) (TOP & BOTTOM)
6	8	N12 U-BARS (300 x 2000)
5	2	N12 L-BARS (300 x 2000)
4	4	N12 L-BARS (300 x 1090)
3	4	N12 L-BARS (300 x 1040)
2	4	N12 L-BARS (300 x 990)
1	13	N10 LIGS (90 x 110)
MATERIAL SCHEDULE		

NOTES:

1. USE CONCRETE STRENGTH N40.
2. TO COMPLY WITH AS3600 & AS1379.
3. PROVIDE 45mm COVER TO REINFORCEMENT (MINIMUM)
4. REINFORCEMENT TO BE D500N BARS TO AS4671.
5. CHAMFER EXTERNAL CORNERS AND FILLET RE-ENTRANT CORNERS 20x20.
6. DO NOT LIFT PANEL UNTIL CONCRETE STRENGTH EXCEEDS 20MPa.
7. NOMINAL INTERNAL DIAMETER OF COGS SHALL BE 5db.
8. MINIMUM MESH LAP SHALL BE WIRE SPACING PLUS 50mm U.N.O.
9. WELD SSP STEEL TAIL TO REBAR AT DIAGONALLY OPPOSED POINTS.
10. FABRICATION TO BE DONE IN ACCORDANCE WITH PWC SPECIFICATION STSP 02-001.

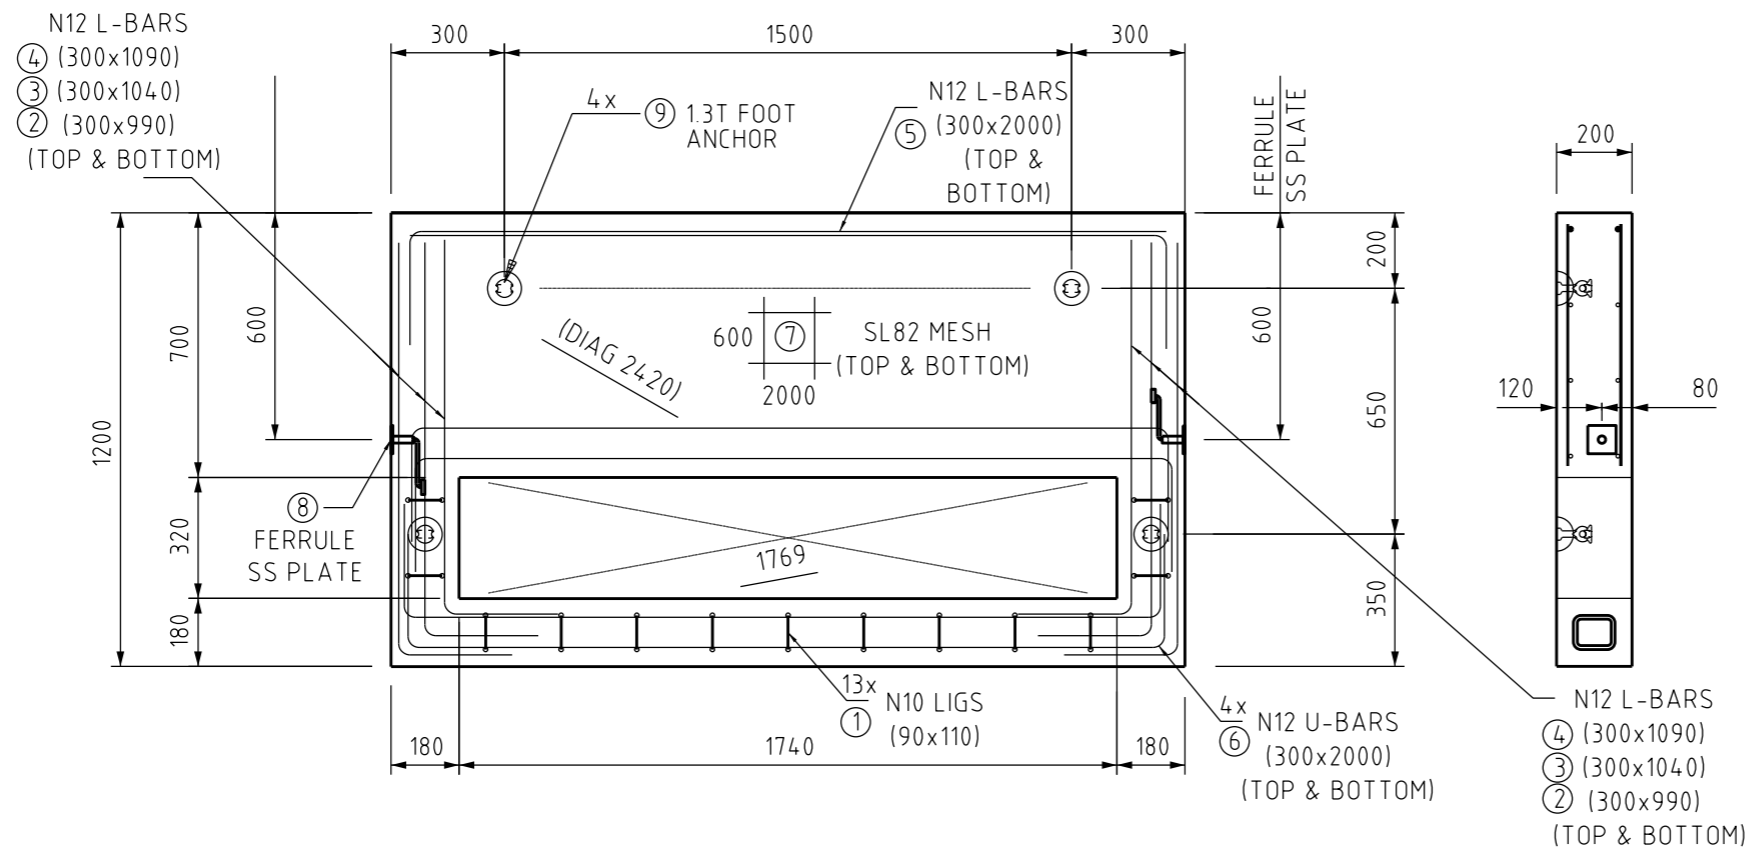

PLAN VIEW
1:20

SECTION
1:20

ITEM NUMBER: 503384

VOLUME: 0.393 m³
WEIGHT: 926.6 Kg

NO	DESCRIPTION	DRN	DATE	CKD	APPD
2	DRAWING RENUMBERED FROM S02-02-06-48 TO MATERIAL DRAWING S02-01-05-14, TITLE UPDATED, MATERIAL SCHEDULE ADDED, CORRECTED SECTION VIEW, NOTES RESTRUCTURED, FERRULE STEEL PLATE CLEARANCE LIMIT ADDED NUMBER TAGS ADDED	R.A.	SEP'21	A.N.	B.V.
1	UPDATED COMMENTS & NOTES	C.C.	DEC'20	B.C.	B.V.
0	ISSUED FOR CONSTRUCTION	C.C.	NOV'20	B.C.	B.V.
AMENDMENTS					



DES		POWER STANDARD DRAWING	
DES	B.VANDERSTELT	PRECAST CONCRETE FOUNDATION, RMU SCHNEIDER RM6	
DRN	C.COPPINS	A3	DRAWING NUMBER S02-01-05-14
CKD	B.CHEUNG		
APPD	B.VANDERSTELT	CAD PRODUCT - DO NOT AMEND MANUALLY	
SCALE	AS SHOWN	AMDT	
ISSUED	NOVEMBER 2020		
ALL DIM. IN mm			
DRAFTING STANDARD TO A.S.1100			